

# **IEC 60870-5-104 Master Driver**

**©2016 Kepware, Inc.**

# Table of Contents

<b>Table of Contents</b> .....	<b>2</b>
IEC 60870-5-104 Master Driver .....	3
Overview .....	3
<b>Channel Setup</b> .....	<b>4</b>
60870 Settings .....	4
<b>Device Setup</b> .....	<b>6</b>
<b>Timing</b> .....	<b>7</b>
Communications .....	7
Event Playback .....	9
<b>Data Type Description</b> .....	<b>10</b>
<b>Address Descriptions</b> .....	<b>11</b>
<b>Error Descriptions</b> .....	<b>16</b>
Device <device name> failed to complete clock synchronization. ....	16
Device <device name> failed to complete counter interrogation. ....	16
Device <device name> failed to complete general interrogation. ....	16
Device <device name> is not responding. ....	17
Error loading XML file for device <device name>. Common address is invalid. Valid range is <low limit> to <high limit>. ....	17
Error loading XML file for device <device name>. Common Address <common address> is already used by device <device name>. ....	17
Read failed on tag <tag name>. ....	17
Read failed on tag <tag name> due to data type mismatch. ....	18
Too many events received in <device name>; the buffer has overflowed. ....	18
Unable to write to address <address> on device <device>. ....	18
Write failed on tag <tag name>. ....	19
<b>IEC 60870-5-104 Interoperability Guide</b> .....	<b>20</b>
<b>Index</b> .....	<b>32</b>

## IEC 60870-5-104 Master Driver

---

Help version 1.023

### CONTENTS

#### [Overview](#)

What is the IEC 60870-5-104 Master Driver?

#### [Channel Setup](#)

How do I configure a channel for use with this driver?

#### [Device Setup](#)

How do I configure devices for use with this driver?

#### [Data Types Description](#)

What data types does the IEC 60870-5-104 Master Driver support?

#### [Address Descriptions](#)

How do I address a data location on a device?

#### [Error Descriptions](#)

What error messages are produced by the IEC 60870-5-104 Master Driver?

#### [IEC 60870-5-104 Interoperability Guide](#)

Where can I find specific implementation information for the IEC 60870-5-104 Master Driver?

### Overview

---


IEC 60870 is a commonly used substation communication protocol similar to DNP. The IEC 60870-5-104 protocol uses specific terms to describe the communications pathway. Descriptions are as follows:

- **Channel:** This describes a communications path between two endpoints.
- **Session:** This describes a logical connection between a 104 master node (server channel) and a 104 slave node (server device). It comprises one or more 104 Sectors.
- **104 Sector:** This groups related data. It has its own Information Object Address (IOA) space. In the IEC 60870-5-104 Master Driver, a 104 session/sector pair is represented as server devices for each channel.

The server channel describes the communications pathway over which the master and slave will communicate. The other endpoint of the 104 channel may have one or more slave nodes and sectors available. A server device must be created for each sector in the endpoint.

## Channel Setup

The Communications dialog is used to specify the destination host and port for communication with an IEC 60870-5-104 device.

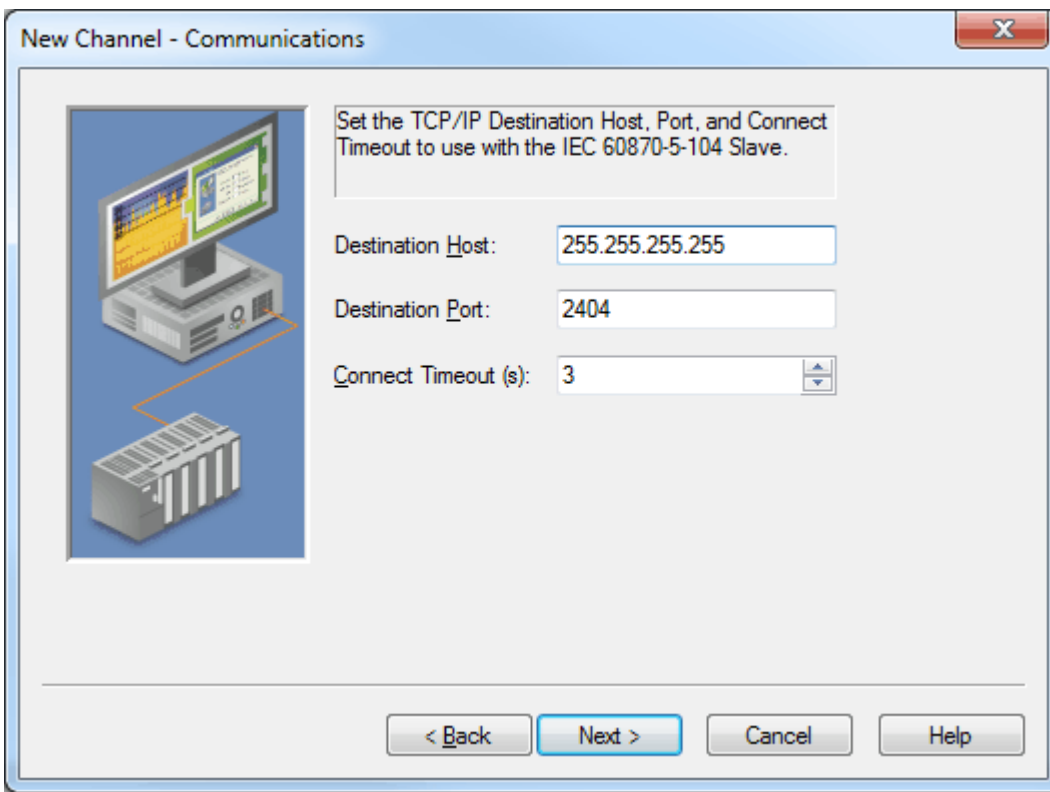

Descriptions of the parameters are as follows:


- **Destination Host:** This parameter specifies the Destination Host, and should match the IP or host name of the IEC 60870-5-104 device or gateway. The default setting is 255.255.255.255.
- **Destination Port:** This parameter specifies the Destination Port. The valid range is 1 to 65535. The IEC 60870-5-104 recommended port is 2404. The default setting is 2404.
- **Connect Timeout:** This parameter specifies the Connect Timeout, which is the amount of time that the server will attempt to connect to the device. The valid range is 1 to 30 seconds. The default setting is 3 seconds.

**Note:** To ensure uninterrupted communications, channels created in the server are required to have a unique Destination Host and Destination Port (Host:IP) combination.

**See Also:** [Settings](#)

## 60870 Settings

The 60870 Settings dialog is used to specify the IEC 60870-5-104 Master Driver settings for communications with a specific channel on a 104 slave.

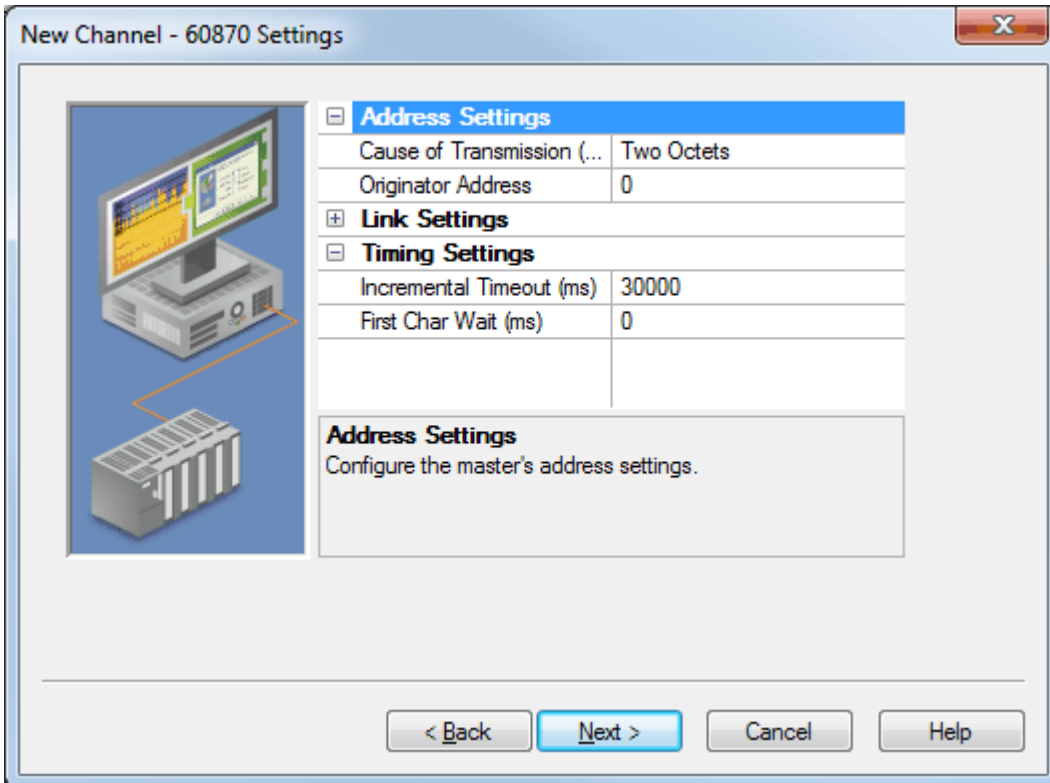

### Address Settings

- **Cause of Transmission (COT) Size** This parameter specifies the number of octets in an ASDU COT field. When Two Octets is selected, the master's originator address is included in messages sent to the slave. When One Octet is selected, the originator address is not included and is disabled in the configuration. The default setting is Two Octets.
- **Originator Address** This parameter specifies the second byte of the Cause of Transmission (COT) field, which is used by a dual-mode device to route responses from a slave to the correct master. The valid range is 0 to 254. The default setting is 0.

### Link Settings

- **T1 (ms):** Time to wait for acknowledge ("ACK") to a transmitted APDU. If this time expires, the master assumes data has been lost and attempts to retransmit. The default settings is 15000 ms.
- **T2 (ms):** Time to wait before sending a supervisory APDU ACK. Increasing this setting can reduce bandwidth required for acknowledging. The default settings is 10000 ms.
- **T3 (ms):** Idle time before sending TEST APDU. This is used by a 104 device to detect device connectivity. The default settings is 20000 ms.
- **K:** Maximum unacknowledged transmitted APDUs. The master does not send more APDUs if the maximum number of ADPUs have been transmitted and have not been acknowledged. The default settings is 12.
- **W:** Maximum unacknowledged received APDUs. This setting works in conjunction with T2 to limit how often the master acknowledges APDUs. Increasing this setting can reduce bandwidth required for acknowledging. The default settings is 8.
- **RX Buffer Size:** This parameter specifies the maximum data size it is possible to receive. Messages containing more than the specified size are discarded. This value can range between 2 and 253. The default setting in 253 bytes.

### Timing Settings

- **Incremental Timeout (ms):** This defines the maximum time to wait for a response from a device when a command is outstanding. The default setting is 30000 ms.
- **First Char Wait (ms):** This parameter specifies how long to wait (in milliseconds) after receiving a character before attempting to transmit a character. The default setting is 0 ms.

## **Device Setup**

---

### **Communication Protocol**

IEC 60870-5-104 Master

**Note:** For more information, refer to [IEC 60870-5-104 Interoperability Guide](#).

### **Supported Devices**

Any IEC 60870-5-104 slave device or gateway.

### **Maximum Channels and Devices**

The maximum number of channels supported is 256 (with one socket allowed per channel). The maximum number of devices supported per channel is 1024.

## Timing


Timing settings come in two varieties: link-layer timing and application-layer timing. Link-layer timing settings are used to control or time out the acquisition of application layer data. Application-layer data contains the individual commands to read or write. For example, General Interrogation is performed as an application-layer command, but the acquisition of individual data is accomplished through the link layer.

Device-level application-layer timeouts are controlled through the request timeout device settings. These settings are the only timing parameters that can affect tag quality.

The channel-level timing settings affect the link layer. They do not directly affect the quality of a tag, but they can be tuned to allow for delays or timeouts during the acquisition of individual data pieces. These settings can introduce complex interactions in data acquisition and should not be changed without a compelling reason.

## Communications

The Communications dialog is used to specify the IEC 60870-5-104 settings to use for communications with a specific sector on a 104 slave.

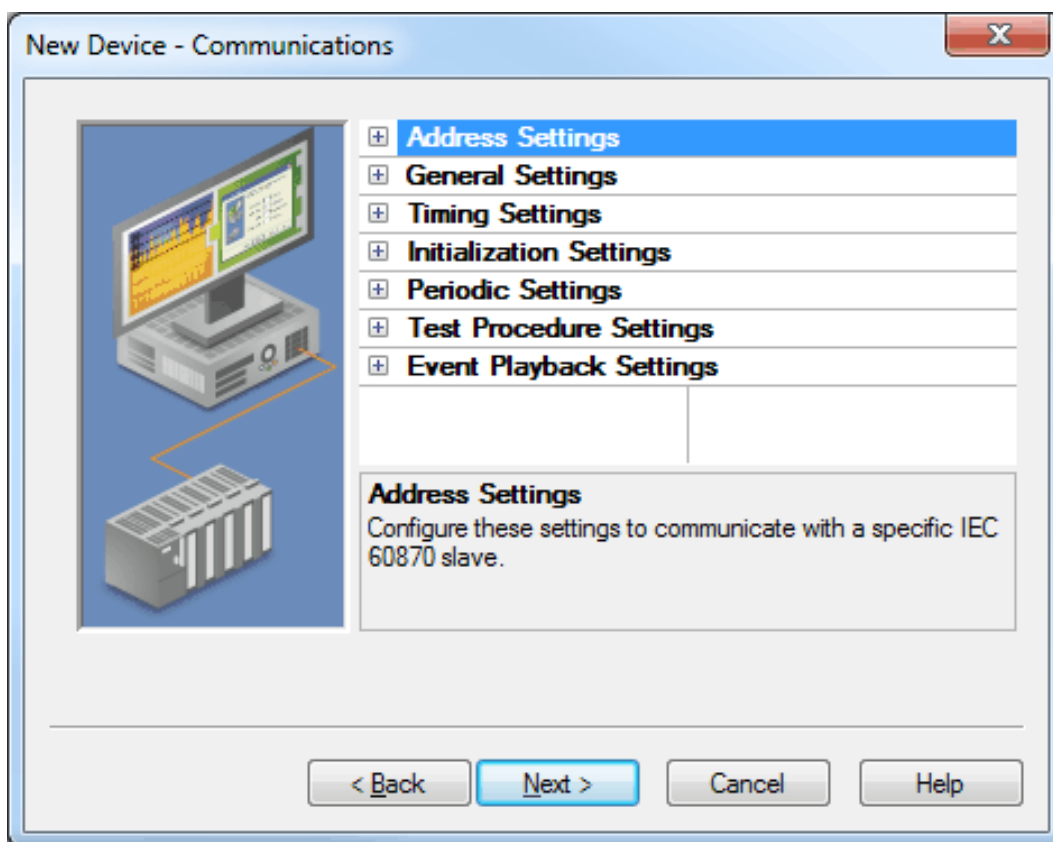

### Address Settings

- **Common Address:** This parameter specifies whether to permit the addressing of the whole station and, optionally, a particular sector within a station. A station represents a physical device; a sector represents a set of data within a device. Sectors are commonly used by pass-through devices (which must separate data from the multiple devices they represent) and by devices that want to segment their data based on type. The valid range is 0 to 254 or 65534, depending on whether the Common Address (ASDU) Size setting is set to one or two octets. The default setting is 3.

**Note:** Devices within a channel must have unique link/common address pairs because the master must have unique sector references within a channel.

### General Settings

- **Polled Reads:** When enabled, unbuffered tags perform polled reads when last-read data is older than the scan rate. When disabled, only previously received cyclic and background scan data is reported. If polled reads are disabled, the driver reports "Uncertain" quality until cyclic or background scan updates have been received. Default is enabled.

### Timing Settings

- **Request Timeout (ms):** This parameter specifies an interval that determines how long the driver waits for a general response from the target device to complete. The default setting is 10000 ms. General Interrogation and Counter Interrogation use their own timeout setting: Interrogation Request Timeout.
- **Interrogation Request Timeout (ms):** This parameter specifies the General and Counter Interrogation request timeouts. Having a separate timeout for interrogation enables larger timeouts for these longer requests.
- **Attempt Count:** This parameter specifies how many times the driver tries a communication request before considering the request to have failed and the device to be in error. The valid range is 1 to 10. The default setting is 3. General Interrogation and Counter Interrogation use their own setting for the number of attempts: Interrogation Attempt Count.
- **Interrogation Attempt Count:** This parameter specifies the number of General and Counter Interrogation attempts.

### Initialization Settings

- **Time Sync Initialization:** Specifies if and when a time synchronization should be sent to the slave during initialization. The default setting is "End of Initialization." This parameter is independent of the Synchronization setting of the Time Synchronization page at the Command.Timesync tag.
  - **End of Initialization:** Perform Time Sync when the device notifies the master that it has ended initialization.
  - **Connect/Reconnect:** Perform Time Sync when a connection is established. This occurs any time the master reestablishes communication with the slave.
  - **None:** Do not perform an initial Time Sync.
- **GI Initialization:** Specifies if and when a General Interrogation (GI) should be sent to the slave during initialization. The default settings is "End of Initialization." This parameter is independent of the Periodic GI Interval setting and the Command.GI command tag.
  - **End of Initialization:** Perform GI when the device notifies the master that it has ended initialization.
  - **Connect/Reconnect:** Perform GI when a connection is established. This occurs any time the master reestablishes communication with the slave.
  - **None:** Do not perform an initial GI.
- **CI Initialization:** Specifies if and when a Counter Interrogation (CI) should be sent to the slave during initialization. The default settings is "End of Initialization." This parameter is independent of the Periodic CI Interval setting and the Command.CI command tag.
  - **End of Initialization:** Perform CI when the device notifies the master that it has ended initialization.
  - **Connect/Reconnect:** Perform CI when a connection is established. This occurs any time the master reestablishes communication with the slave.
  - **None:** Do not perform an initial CI.

### Periodic Settings

- **Periodic GI Interval (minutes):** Configures the master to perform a General Interrogation based on a specified time interval. The default setting is 720 minutes (12 hours). When clients are connected, General Interrogations are sent every time the specified period elapses. Specifying an interval of 0 disables periodic GI.
- **Periodic CI Interval (minutes):** Configures the master to perform a Counter Interrogation based on a specified time interval. When clients are connected, Counter Interrogations are sent every time the specified period elapses. The default setting is 0 minutes (disabled). Specifying an interval of 0 disables periodic CI.

### Test Procedure Settings



- **Test Procedure:** Specifies whether or not test command is enabled. When enabled, the master periodically sends a test command ASDU. This command can be used to determine device error state. It is not recommended to enable this setting because the TCP/IP layer handles connectivity detection. The default setting is disabled.
- **Test Procedure Period (seconds):** Test commands are sent at the specified rate. The default setting is 15 seconds.

### Playback Settings

- **Playback Events:** Specifies whether or not event playback is enabled. When disabled, all tags associated with event playback report the most recent data and no data is buffered. When enabled, events are played back based on the buffer size and playback rate. The default setting is Enabled. See [Event Playback](#).
- **Playback Buffer Size:** The maximum number of events buffered for each Information Object Address (IOA) buffer. The default setting is 100.
- **Playback Rate (ms):** Rate at which events are played back. The default setting is 2000 ms.

### Event Playback

---

A device may send many updates in one transaction. To address this, event playback handles spontaneously transmitted data. For example, if a device sends a set of packed events that represent some history of an analog event (such as voltage values during a fault), the data is played back. The driver plays back each data point at a set interval to allow the client to read each update in the order it was received from the device.

Event playback also guarantees that each data point is read. If the interval expires before the data has been accessed, the data is maintained until the client references it.

To guarantee that no data is missed, it is recommended that client update rates be at least as fast as the event playback interval. This is not required with a single client because data is held until at least one read has occurred; however, it is required in the case of multiple clients reading the same data point to ensure that each client receives all the data.

The quality of buffered tags is "uncertain" until data associated with a tag(s) is received. If a DNR occurs during event playback, all buffered events are played back before reporting "bad" quality.

#### Notes:

1. Please see the OPC DA Compliance note for OPC DA Compliance settings that can affect event playback.
2. The OPC timestamp is based on the device time (if available) or the server time. When the OPC timestamp is based on server time, it represents the time of the data arrival.

**Data Type Description**

---

<b>Data Type</b>	<b>Description</b>
Boolean	Single bit
Float	32-bit floating-point value
Byte	Unsigned 8-bit value Bit 0 is the low bit Bit 7 is the high bit
Date	64-bit value representing the number of milliseconds since December 31, 1899
Char	Signed 8-bit data
Word	Unsigned 16-bit data
DWord	Unsigned 32-bit data
Short	Signed 16-bit data
Long	Signed 32-bit data

## Address Descriptions

There are two forms of tag addressing. The first is information object address (IOA) based tag addressing, which allows access to each individual data point on a device. IOA-based tag addressing includes monitor ASDUs and control ASDUs. The second form is device-level command-based tag addressing, which allows control of device-specific commands.

### [IOA-Based Tag Addressing](#)

#### [Monitor ASDUs](#)

#### [Control ASDUs](#)

### [Command-Based Tag Addressing](#)

## IOA-Based Tag Addressing

Tag addressing takes the form *TYPEID.IOA.SUB-TYPE.OPTIONAL.OPTIONAL*, where:

- *TYPEID* is the ASDU type.
- *IOA* is the Information Object Address (IOA).
- *SUB-TYPE* is the point's driver-specific attribute.
- *OPTIONAL* is an attribute that is not required.

**Note:** The Information Object Address (IOA) represents a slave device's point address. It is an integer between 1 and 254, 65535, or 16777215; depending on whether the Information Object Address Size property is set to one, two, or three octets (respectively).

### TYPEID

The TYPEID represents the ASDU type as defined by the protocol. Types include monitor or control. Each monitor TYPEID supports multiple protocol-defined ASDU numbers. Monitor types represent data that is read only. Control types represent data that can be written.

#### [Monitor ASDUs](#)

#### [Control ASDUs](#)

## Monitor ASDUs

Monitor TYPEID	Data Type	ASDU	Description
M_SP	Boolean	1, 30	Single-Point Information
M_DP	Char	3, 31	Double-Point Information: Possible values are 0, 1, 2, and 3. 0: Indeterminate or Intermediate State 1: Determined State OFF 2: Determined State ON 3: Indeterminate State
M_ST	Char	5, 32	Step Position Information: Possible values are -64 to +63. Supports the Transient sub-type.
M_BO	DWord	7, 33	Bit string of 32 bit. Support bit indexing into the following sub-types: Value and CurrentValue.
M_ME_NV	Float	9, 21, 34	Measured Value, Normalized Value: This represents a value between -1 and 0.999969482421875. Devices transmit this value and the driver converts this into its appropriate floating-point value.
M_ME_SV	Short	11, 35	Measured Value, Scaled Value. Possible values are -32768 to +32767.
M_ME_FV	Float	13, 36	Measured Value, Short Floating Point Number.
M_IT	Long	15, 37	Integrated Totals. Supports the SQ sub-type. Does not support unbuffered "Current" sub-types.

### SUB-TYPE

The SUB-TYPES that are available are determined by the TYPEID. Monitor TYPEIDs can only use monitor SUB-TYPES. For more information, refer to the table below.

SUB-TYPE	Data Type	Description
Value	See TYPEID	The Event Playback value. Values received during General Interrogation (GI) and event acquisition are played back with this tag. If the quality descriptor IV (invalid) bit is set, this tag shows bad quality.  When used with M_BO, this supports bit indexing. For example, to access bit 0 in the value tag, use the sub-type Value with .0 appended: Value.0.
CurrentValue*	See TYPEID	This reports all unbuffered data; which includes cyclic, background scan, and polled reads. If the quality descriptor IV (invalid) bit is set, this tag shows bad quality. When used with M_BO, this supports bit indexing. For example, to access bit 0 in the value tag, use the sub-type CurrentValue with .0 appended: CurrentValue.0.  Not supported for M_IT.  Polled reads are performed with the read command: C_RD Type ID 102. Although the standard considers this a control operation, the physical reads are performed with the monitor TYPEIDs.
Timestamp	Date	The Event Playback timestamp. Timestamps received during GI, event acquisition, cyclic updates, and background scans are played back with this tag. If the device provides data without a timestamp, the Timestamp tag value is set to 1899-12-30T00:00:00.000 and it is set to bad quality.
CurrentTimestamp*	Date	Same as Timestamp, but with unbuffered data.
QualityDesc	Byte	The Event Playback quality description field. Quality descriptions received during GI, event acquisition, cyclic updates, and background scans will be played back with this tag.
CurrentQualityDesc*	Byte	Same as QualityDesc, but with unbuffered data.
COT	Word	The Event Playback Cause of Transmission (COT) field. For COT values as specified in 60870-5-104, section 7.2.3, refer to the table below.
CurrentCOT*	Word	Same as COT, but with unbuffered data.
Transient	Boolean	The Event Playback Transient bit associated with M_ST ASDU type. 0: Equipment is not in transient state. 1: Equipment is in transient state.
CurrentTransient*	Boolean	The same as the Transient, but with unbuffered data.
SQ	Char	The event playback sequence field associated with the M_IT ASDU type. A number between 0 and 31 represents the sequence notation.

\* For all the SUB-TYPES with "Current" in the name, cyclic or background data is reported if it has been recently received. If there has not been an update for a significant period of time and polled reads are enabled, a polled read with the read command ASDU is performed. This is accomplished by monitoring a tag's scan rate. Cyclic and background scan data is reported only if it is newer than a tag's scan rate. If the quality descriptor IV (invalid) bit is set, this tag shows bad quality.

#### Cause of Transmission (COT)

The Cause of Transmission field is enumerated according to the table below, which is based on the IEC 60870-5-104 specification.

**Note:** All causes of transmission (with the exception of requested transmission, background scan, and periodic / cyclic) are handled by event playback. Users can access events, general interrogation, and counter interrogation utilizing the Value tag, Timestamp tag, QualityDesc tag, and COT tag. Requested, background scan, and cyclic unbuffered data can be accessed by utilizing the CurrentValue tag, CurrentTimestamp tag, CurrentQualityDesc tag, and CurrentCOT tag.

COT Value	Cause
0	Not used
1	Periodic, cyclic
2	Background scan
3	Spontaneous
4	Initialized
5	Request or requested
6	Activation
7	Activation confirmation

COT Value	Cause
8	Deactivation
9	Deactivation confirmation
10	Activation termination
11	Return information caused by a remote command
12	Return information caused by a local command
13	File transfer
14-19	Reserved for further compatible definitions
20	Interrogated by station interrogation
21-36	Interrogated by group 1-16 interrogation
37	Requested by general counter request
38-41	Requested by group 1-4 counter request
42-43	Reserved for further compatible definitions
44	Unknown type identification
45	Unknown Cause of Transmission
46	Unknown Common Address (ASDU)
47	Unknown Information Object Address (IOA)
48-63	For special use (private range)

#### Buffered, Monitor ASDUs Examples

If a client needs access to double-point data in IOA 200 to capture events generated for this point. Events (COT = Spontaneous) are buffered so that all events are captured and played back to the client in chronological order. The following tags expose all the data related to IOA 200.

*M\_DP.200.VALUE*  
*M\_DP.200.TIMESTAMP*  
*M\_DP.200.COT*  
*M\_DP.200.QUALITYDESC*

ASDUs that contain structured data expose additional sub-types to expose the data. For example, integrated totals (M\_IT) contain a count (exposed in the VALUE sub-type) and sequence (exposed in the SQ sub-type). The following tags expose all data related to integrated total data in IOA 800.

*M\_IT.800.VALUE*  
*M\_IT.800.SQ*  
*M\_IT.800.TIMESTAMP*  
*M\_IT.800.COT*  
*M\_IT.800.QUALITYDESC*

#### Unbuffered, Monitor ASDUs

If a client needs access to measured, floating-point data in IOA 700 and the slave is configured to transmit data periodically (COT = Cyclic) every 60 seconds. The clients should access "current" (unbuffered) tags. All ASDUs and sub-type are available with "current" sub-types, except integrated totals (M\_IT) because the protocol does not support polled reads or cyclic transmission of integrated totals. The following tags expose all the data related to IOA 700.

*M\_ME\_FV.700.CURRENTVALUE*  
*M\_ME\_FV.700.CURRENTTIMESTAMP*  
*M\_ME\_FV.700.CURRENTCOT*  
*M\_ME\_FV.700.CURRENTQUALITYDESC*

If the client update rate is greater than or equal to the slave's configured cyclic transmission rate (60 seconds in this example), the driver only performs a polled read to determine the tag's initial value. After the initial read, the driver receives cyclic updates and provides the client the latest cyclic slave transmission. If the client update rate is faster than the slave cyclic transmission rate, the driver performs a polled read anytime the data is older than the client scan rate. For example, if the client update rate is 10 seconds, the driver performs a polled read every 10 seconds unless the cyclic data is less than 10 seconds old. Polled reads can be disabled in the device configuration.

#### Control ASDUs

These Control ASDUs are write only.

Control TYPEID	Data Type	ASDU	Description
C_SC	Boolean	45, 58	Single Command
C_DC	Char	46, 59	Double Command. Possible values are 1 and 2. 0: Not Permitted 1: Determined State OFF 2: Determined State ON 3: Not Permitted
C_RC	Char	47, 60	Regulating Step Command. Possible values are 1 and 2. 0: Not Permitted 1: Next Step LOWER 2: Next Step HIGHER 3: Not Permitted
C_SE_NV	Float	48, 61	Measured Value, Normalized Value: This represents a value between -1 and 0.999969482421875. Values outside the range fail and report bad quality.
C_SE_SV	Short	49, 62	Set point command, scaled value.
C_SE_FV	Float	50, 63	Set point command, Short Floating Point Number.
C_BO	DWord	51, 64	Bit string of 32 bits. Does not support bit indexing.

### SUB-TYPE

The SUB-TYPES that are available are determined by the TYPEID. Control TYPEIDs can only use control SUB-TYPES. For more information, refer to the table below.

SUB-TYPE	Data Type	Description
SelectExecuteValue	See TYPEID	The two-step write value. Writing to this causes the associated command ASDU to write to a device using select-and-execute. In this mode, writes occur with a dual command/response from the device.
DirectValue	See TYPEID	The single-step write value. Writing to this causes the associated command ASDU to write to a device using direct execute. In this mode, writes occur with a single command/response with the device.

### OPTIONAL

The below parameters can be included with select Control TYPEIDs, but are not required. These allow access to additional Control SUB-TYPE options. Optional addressing can be used in any order.

OPTION	Applicable TypeIDs	Description
Timestamp	All Control ASDUs	Control ASDU includes the master system time in the transmitted command. If not included, timestamp is not transmitted. These are effected by the configured time zone settings.
ShortPulse	C_SC C_DC C_RC	Control ASDU includes ShortPulse QoC. Only one of ShortPulse, LongPulse, or Persistent may be used at a time. Not specifying allows the device to use its default setting.
LongPulse	C_SC C_DC C_RC	Control ASDU includes LongPulse QoC. Only one of ShortPulse, LongPulse, or Persistent may be used at a time. Not specifying allows the device to use its default setting.
Persistent	C_SC C_DC C_RC	Control ASDU includes Persistent QoC. Only one of ShortPulse, LongPulse, or Persistent may be used at a time. Not specifying allows the device to use its default setting.

"No additional definition" (value of 0) is used for command tags that support the Qualifier of Command (QoC) syntax, but have no QoC option is specified.

### Control ASDUs Examples

If a client must control single-point data monitored with IOA 100, it can be accomplished with control ASDUs. In 60870-5-104, monitor IOAs are read-only (used to transfer data from the slave to the master) and cannot be written. The slave; however, may be configured to expose a single control IOA at point 2100 such that it correlates to the monitor IOA 100 (for the same point). When the master changes the value of IOA 2100, the change is reflected in the monitored single-point IOA 100. The following tags can be used to send control ASDUs to the slave for single-point 2100.

*C\_SC.2100.SELECTEXECUTEVALUE*  
*C\_SC.2100.DIRECTVALUE*

The client should use the tag that represents the desired write strategy. In addition to the write strategy, an optional write qualifier can be used to specify the slave's behavior. The following tags represent several options that can adjust the write qualifier. The write qualifier can be used with *C\_SC*, *C\_DC*, and *C\_RC* control ASDUs. All write qualifiers are supported for both the *DIRECTVALUE* and *SELECTEXECUTEVALUE* sub-types.

*C\_SC.2100.SELECTEXECUTEVALUE.PERSISTENT*  
*C\_SC.2100.DIRECTVALUE.LONGPULSE*  
*C\_SC.2100.DIRECTVALUE.PERSISTENT*  
*C\_SC.2100.SELECTEXECUTEVALUE.SHORTPULSE*

In addition to the write qualifier, the IEC 60870-5-104 protocol also supports control ASDUs that include a timestamp. The driver automatically uses the timestamped control ASDU when the tag includes the *TIMESTAMP* optional syntax. This optional modifier can be used with any permutation of the write strategy and write qualifier.

*C\_SC.2100.SELECTEXECUTEVALUE.PERSISTENT.TIMESTAMP*  
*C\_SC.2100.DIRECTVALUE.LONGPULSE.TIMESTAMP*  
*C\_SC.2100.DIRECTVALUE.PERSISTENT.TIMESTAMP*  
*C\_SC.2100.SELECTEXECUTEVALUE.SHORTPULSE.TIMESTAMP*

### Command-Based Tag Addressing

Tag addressing takes the form *TYPE.COMMAND*, where:

- *TYPE* is the string: Command.
- *COMMAND* is the command to be run.

### COMMAND

An example command address is: "Command.GI".

SUB-TYPE	Description
Command.GI	Global General Interrogation (GI) is issued when a client writes any value to this tag. This asks a device for any data assigned to general interrogation.
Command.CI	Global Counter Interrogation (CI) is issued when a client writes any value to this tag. This asks any integrated totals.
Command.FreezeCounters	Global Freeze Counter Interrogation is issued when a client writes any value to this tag. This stops counting integrated totals.
Command.ResetCounters	Global Reset Counter Interrogation is issued when a client writes any value to this tag. This returns all integrated totals to 0.
Command.FreezeResetCounters	Global Freeze and Reset Counter Interrogation is issued when a client writes any value to this tag. This stops all integrated totals and returns all integrated totals to 0.
Command.TimeSync	Time Sync is issued when a client writes any value to this tag. This synchronizes the master clock with the slave clock.
Command.TestProcedure	Test Procedure is issued when a client writes any value to this tag. This checks a device to see if it is connected.

## Error Descriptions

---

The following messages may be generated. Click on the link for a description of the message.

### Error Messages

[Device <device name> failed to complete clock synchronization.](#)

[Device <device name> failed to complete counter interrogation.](#)

[Device <device name> failed to complete general interrogation.](#)

[Device <device name> is not responding.](#)

[Error loading XML file for <device name>. Common address is invalid.](#)

[Error loading XML file for <device name>. Common address already used by <device name>.](#)

[Read failed on tag <tag name>.](#)

[Read failed on tag <tag name> due to data type mismatch.](#)

[Too many events received in <device name>; the buffer has overflowed.](#)

[Unable to write to address <address> on device <device>.](#)

[Write failed on tag <tag name>.](#)

### **Device <device name> failed to complete clock synchronization.**

---

#### Error Type:

Warning

#### Possible Cause:

1. Communications were lost.
2. Communications timed out.

#### Solution:

1. Service the device connection.
2. Increase the value of the device's clock synchronization request timeout setting.

### **Device <device name> failed to complete counter interrogation.**

---

#### Error Type:

Warning

#### Possible Cause:

1. Communications were lost.
2. Communications timed out. This can occur when the time to send all counter interrogation data exceeds the Interrogation Request Timeout.

#### Solution:

1. Service the device connection.
2. Increase the value of the device interrogation request timeout setting.

### **Device <device name> failed to complete general interrogation.**

---

#### Error Type:

Warning

#### Possible Cause:

1. Communications were lost.
2. Communications timed out. This can occur when the time to send all general interrogation data exceeds the request timeout.

#### Solution:

1. Service the device connection.



2. Increase the value of that device's interrogation request timeout setting.

---

**Device <device name> is not responding.**

---

**Error Type:**

Serious

**Possible Cause:**

1. The connection between the device and the host PC is broken.
2. The communications parameters for the connection are incorrect.
3. The named device may have been assigned an incorrect network ID.
4. A device on the channel is unresponsive, due to improper timing settings or a broken communications link.
5. There are multiple channels using DNS host names that resolve to the same IP address.
6. The response from the device took longer to receive than the amount of time specified in the Request Timeout device setting.

**Solution:**

1. Verify the cabling between the IEC 60870 master and the IEC 60870 slave device.
2. Verify that the specified communications parameters match those of the device.
3. Verify that the network ID given to the named device matches that of the actual device.
4. Locate the unresponsive device and correct the timing settings or fix the broken communications link.
5. Ensure that all channels are using a unique Destination Host.
6. Increase the Request Timeout setting so that the entire response can be handled.

---

**Error loading XML file for device <device name>. Common address is invalid. Valid range is <low limit> to <high limit>.**

---

**Error Type:**

Error

**Possible Cause:**

The XML project being loaded specifies a common address that is not valid with the Common Address Size setting.

**Solution:**

- Increase the Common Address Size. Possible values are 1 Octet or 2 Octets.
- Update the Common Address so that it is within the allowed range.

---

**Error loading XML file for device <device name>. Common Address <common address> is already used by device <device name>.**

---

**Error Type:**

Error

**Possible Cause:**

More than one device in the channel has the same common address pair.

**Solution:**

Verify every device in the channel has a unique address.

---

**Read failed on tag <tag name>.**

---

**Error Type:**

Warning

**Possible Cause:**

A device is connected, but the tag is not appropriate for the device. For example, the ASDU type or IOA may not be appropriate for the data on the device.

**Solution:**

Correct the tag address to match the device's configuration.

**See Also:**

[Address Descriptions](#)

**Read failed on tag <tag name> due to data type mismatch.****Error Type:**

Warning

**Possible Cause:**

Tag ASDU type is incorrect. This error occurs when data is received from the device at this IOA, but it represents a different ASDU type.

**Solution:**

Verify or correct the ASDU type. Correct the tag address to match the device configuration.

**See Also:**

[Address Descriptions](#)

**Too many events received in <device name>; the buffer has overflowed.****Error Type:**

Warning

**Possible Cause:**

The slave is producing events faster than the client can consume them.

**Solution:**

Increase the event playback buffer size. The per-item event buffer size should be large enough to handle the data at the highest per-item event transmission speed. For example, if a slave may transmit 100 events in 5 seconds and the event playback rate is set to 5 seconds, the event buffer will overflow if more than 100 events are received in a 5-second period.

**Unable to write to address <address> on device <device>.****Error Type:**

Warning

**Possible Cause:**

1. Incorrect common address; the device is not responding.
2. The point does not exist in the slave.
3. The address has an incorrect data type.

**Solution:**

1. Correct the common address to match the slave.
2. Correct the Information Object Address(IOA).
3. Correct the data type for the address.

**See Also:**

[Address Descriptions](#)

**Write failed on tag <tag name>.**

---

**Error Type:**

Warning

**Possible Cause:**

Attempted to write to a tag outside the supported range.

**Solution:**

Note the minimum and maximum values and limit writes within the supported range.

**See Also:**

[Address Descriptions](#)

## IEC 60870-5-104 Interoperability Guide

The following reference material is from the International Electrotechnical Commission (IEC).

### Interoperability

This companion standard presents sets of parameters and alternatives from which subsets have to be selected to implement particular telecontrol systems. Certain parameter values, such as the number of octets in the COMMON ADDRESS of ASDUs represent mutually exclusive alternatives. This means that only one value of the defined parameters is admitted per system. Other parameters, such as the listed set of different process information in command and in monitor direction allow the specification of the complete set or subsets, as appropriate for given applications. This Clause summarizes the parameters of the previous Clauses to facilitate a suitable selection for a specific application. If a system is composed of equipment stemming from different manufacturers, it is necessary that all partners agree on the selected parameters.

The interoperability list is defined as in IEC 60870-5-101 and extended with parameters used in this standard. The text descriptions of parameters which are not applicable to this companion standard are strike-through (corresponding check box is marked black).

**Note:** In addition, the full specification of a system may require individual selection of certain parameters for certain parts of the system, such as the individual selection of scaling factors for individually addressable measured values.

The selected parameters should be marked in the white boxes as follows:

- Function or ASDU is not used
- Function or ASDU is used as standardized (default)
- Function or ASDU is used in reverse mode
- Function or ASDU is used in standard and reverse mode

The possible selection (blank, X, R, or B) is specified for each specific clause or parameter.

A black check box indicates that the option cannot be selected in this companion standard.

### System or Device

(system-specific parameter, indicate the station's function by marking one of the following with 'X')

- System definition
- Controlling station definition (Master)
- Controlling station definition (Slave)

### Network configuration

(network-specific parameter, all configurations that are used are to be marked with an "X")

- Point-to-point
- Multiple point-to-point
- Multipoint-party line
- Multipoint-star

### Physical layer

(network-specific parameter, all interfaces and data rates that are used are to be marked with an "X")

#### Transmission speed (control direction)

- |   |   |  |
|---|---|--|
| Unbalanced interchange<br>Circuit V.24/V.28<br>Standard | Unbalanced interchange<br>Circuit V.24/V.28<br>Recommended if > 1 200 bit/s | Balanced interchange<br>Circuit X.24/X.27      |
| <input checked="" type="checkbox"/> 100 bit/s           | <input checked="" type="checkbox"/> 2400 bit/s                              | <input checked="" type="checkbox"/> 2400 bit/s |

<input type="checkbox"/> 200 bit/s	<input type="checkbox"/> 4800 bit/s	<input type="checkbox"/> 4800 bit/s
<input type="checkbox"/> 300 bit/s	<input type="checkbox"/> 9600 bit/s	<input type="checkbox"/> 9600 bit/s
<input type="checkbox"/> 600 bit/s		<input type="checkbox"/> 19200 bit/s
<input type="checkbox"/> 1200 bit/s		<input type="checkbox"/> 38400 bit/s
		<input type="checkbox"/> 56000 bit/s
		<input type="checkbox"/> 64000 bit/s

**Transmission speed (monitor direction)**

Unbalanced interchange  
Circuit V.24/V.28  
Standard

<input type="checkbox"/> 100 bit/s
<input type="checkbox"/> 200 bit/s
<input type="checkbox"/> 300 bit/s
<input type="checkbox"/> 600 bit/s
<input type="checkbox"/> 1200 bit/s

Unbalanced interchange  
Circuit V.24/V.28  
Recommended if > 1 200 bit/s

<input type="checkbox"/> 2400 bit/s
<input type="checkbox"/> 4800 bit/s
<input type="checkbox"/> 9600 bit/s

Balanced interchange  
Circuit X.24/X.27

<input type="checkbox"/> 2400 bit/s
<input type="checkbox"/> 4800 bit/s
<input type="checkbox"/> 9600 bit/s
<input type="checkbox"/> 19200 bit/s
<input type="checkbox"/> 38400 bit/s
<input type="checkbox"/> 56000 bit/s
<input type="checkbox"/> 64000 bit/s

**Link layer**

(network-specific parameter, all options that are used are to be marked with an "X". Specify the maximum frame length. If a non-standard assignment of class 2 messages is implemented for unbalanced transmission, indicate the type ID and COT of all messages assigned to class 2.)

~~Frame format FT 1.2, single character 1 and the fixed time out interval are used exclusively in this companion standard.~~

**Link transmission procedure**

<input type="checkbox"/> Balanced transmission
<input type="checkbox"/> Unbalanced transmission

**Address field of link**

<input type="checkbox"/> Not present (balanced transmission only)
<input type="checkbox"/> One octet
<input type="checkbox"/> Two octets
<input type="checkbox"/> Structured
<input type="checkbox"/> Unstructured

**Frame length**

<input type="checkbox"/> Maximum length L (number of octets)
--

When using an unbalanced link layer, the following ASDU types are returned in class 2 messages (low priority) with the indicated causes of transmission:

~~The standard assignment of ASDUs to class 2 messages is used as follows:~~

Type identification	Cause of transmission
9, 11, 13, 21	<1>

A special assignment of ASDUs to class 2 messages is used as follows:

Type identification	Cause of transmission

**Note:** In response to a class 2 poll, a controlled station may respond with class 1 data when there is no class 2 data available.

### Application layer

Transmission mode for application data

Mode 1 (Least significant octet first), as defined in clause 4.10 of IEC 60870-5-4, is used exclusively in this companion standard.

#### Common address of ASDU

(system-specific parameter, all configurations that are used are to be marked "X")

One octet

Two octets

#### Information object address

(system-specific parameter, all configurations that are used are to be marked "X")

One octet

Two octets

Three octets

Structured

Unstructured

#### Cause of transmission

(system-specific parameter, all configurations that are used are to be marked "X")

One octet

Two octets (with originator address)

**Note:** Set to zero in case of no originator address.

#### Length of APDU

(system-specific parameter, specify the maximum length of the APDU per system)

The maximum length of APDU for both directions is 253. It is a fixed system parameter.

Maximum length of APDU per system in control direction

Maximum length of APDU per system in monitor direction

#### Selection of standard ASDUs

##### Process information in monitor direction

(station-specific parameter, mark each type ID with an "X" if it is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions)

X	<1>	:= Single-point information	M_SP_NA_1
	<2>	:= <del>Single-point information with time tag</del>	<del>M_SP_TA_1</del>
X	<3>	:= Double-point information	M_DP_NA_1
	<4>	:= <del>Double-point information with time tag</del>	<del>M_DP_TA_1</del>
X	<5>	:= Step position information	M_ST_NA_1
	<6>	:= <del>Step position information with time tag</del>	<del>M_ST_TA_1</del>
X	<7>	:= Bitstring of 32 bit	M_BO_NA_1
	<8>	:= <del>Bitstring of 32 bit with time tag</del>	<del>M_BO_TA_1</del>
X	<9>	:= Measured value, normalized value	M_ME_NA_1
	<10>	:= <del>Measured value, normalized value with time tag</del>	<del>M_ME_TA_1</del>
X	<11>	:= Measured value, scaled value	M_ME_NB_1
	<12>	:= <del>Measured value, scaled value with time tag</del>	<del>M_ME_TB_1</del>
X	<13>	:= Measured value, short floating point value	M_ME_NC_1
	<14>	:= <del>Measured value, short floating point value with time tag</del>	<del>M_ME_TC_1</del>
X	<15>	:= Integrated totals	M_IT_NA_1
	<16>	:= <del>Integrated totals with time tag</del>	<del>M_IT_TA_1</del>
	<17>	:= <del>Event of protection equipment with time tag</del>	<del>M_EP_TA_1</del>
	<18>	:= <del>Packed start events of protection equipment with time tag</del>	<del>M_EP_TB_1</del>
	<19>	:= <del>Packed output circuit information of protection equipment with time tag</del>	<del>M_EP_TC_1</del>
	<20>	:= Packed single-point information with status change detection	M_PS_NA_1
X	<21>	:= Measured value, normalized value without quality descriptor	M_ME_ND_1
X	<30>	:= Single-point information with time tag CP56Time2a	M_SP_TB_1
X	<31>	:= Double-point information with time tag CP56Time2a	M_DP_TB_1
X	<32>	:= Step position information with time tag CP56Time2a	M_ST_TB_1
X	<33>	:= Bitstring of 32 bit with time tag CP56Time2a	M_BO_TB_1
X	<34>	:= Measured value, normalized value with time tag CP56Time2a	M_ME_TD_1
X	<35>	:= Measured value, scaled value with time tag CP56Time2a	M_ME_TE_1
X	<36>	:= Measured value, short floating point value with time tag CP56Time2a	M_ME_TF_1
X	<37>	:= Integrated totals with time tag CP56Time2a	M_IT_TB_1
	<38>	:= Event of protection equipment with time tag CP56Time2a	M_EP_TD_1
	<39>	:= Packed start events of protection equipment with time tag CP56time2a	M_EP_TE_1
	<40>	:= Packed output circuit information of protection equipment with time tag CP56Time2a	M_EP_TF_1

In this companion standard, only the use of the set <30> - <40> for ASDUs with time tag is permitted.

#### Process information in control direction

(station-specific parameter, mark each Type ID 'X' if it is only used in the standard direction, 'R' if only used in the reverse direction, and 'B' if used in both directions)

X	<45>	:= Single command	C_SC_NA_1
X	<46>	:= Double command	C_DC_NA_1
X	<47>	:= Regulating step command	C_RC_NA_1
X	<48>	:= Set-point command, normalized value	C_SE_NA_1
X	<49>	:= Set-point command, scaled value	C_SE_NB_1
X	<50>	:= Set-point command, short floating point value	C_SE_NC_1

<input checked="" type="checkbox"/>	<51>	:= Bitstring of 32 bit	C_BO_NA_1
<input checked="" type="checkbox"/>	<58>	:= Single command with time tag CP56Time2a	C_SC_TA_1
<input checked="" type="checkbox"/>	<59>	:= Double command with time tag CP56Time2a	C_DC_TA_1
<input checked="" type="checkbox"/>	<60>	:= Regulating step command with time tag CP56Time2a	C_RC_TA_1
<input checked="" type="checkbox"/>	<61>	:= Set-point command, normalized value with time tag CP56Time2a	C_SE_TA_1
<input checked="" type="checkbox"/>	<62>	:= Set-point command, scaled value with time tag CP56Time2a	C_SE_TB_1
<input checked="" type="checkbox"/>	<63>	:= Set-point command, short floating point value with time tag CP56Time2a	C_SE_TC_1
<input checked="" type="checkbox"/>	<64>	:= Bitstring of 32 bit with time tag CP56Time2a	C_BO_TA_1

Either the ASDUs of the set <45> – <51> or of the set <58> – <64> are used.

#### System information in monitor direction

(station-specific parameter, mark each Type ID 'X' if it is only used in the standard direction, 'R' if only used in the reverse direction, and 'B' if used in both directions)

<input checked="" type="checkbox"/>	<70>	:= End of initialization	M_EI_NA_1
-------------------------------------	------	--------------------------	-----------

#### System information in control direction

(station-specific parameter, mark each Type ID 'X' if it is only used in the standard direction, 'R' if only used in the reverse direction, and 'B' if used in both directions)

<input checked="" type="checkbox"/>	<100>	:= Interrogation command	C_IC_NA_1
<input checked="" type="checkbox"/>	<101>	:= Counter interrogation command	C_CI_NA_1
<input checked="" type="checkbox"/>	<102>	:= Read command	C_RD_NA_1
<input checked="" type="checkbox"/>	<103>	:= Clock synchronization command	C_CS_NA_1
<input type="checkbox"/>	<del>&lt;104&gt;</del>	<del>:= Test command</del>	<del>C_TS_NB_1</del>
<input type="checkbox"/>	<105>	:= Reset process command	C_RP_NC_1
<input type="checkbox"/>	<del>&lt;106&gt;</del>	<del>:= Delay acquisition command</del>	<del>C_CD_NA_1</del>
<input checked="" type="checkbox"/>	<107>	:= Test command with time tag CP56time2a	C_TS_TA_1

#### Parameter in control direction

(station-specific parameter, mark each Type ID 'X' if it is only used in the standard direction, 'R' if only used in the reverse direction, and 'B' if used in both directions)

<input type="checkbox"/>	<110>	:= Parameter of measured value, normalized value	P_ME_NA_1
<input type="checkbox"/>	<111>	:= Parameter of measured value, scaled value	P_ME_NB_1
<input type="checkbox"/>	<112>	:= Parameter of measured value, short floating point value	P_ME_NC_1
<input type="checkbox"/>	<113>	:= Parameter activation	P_AC_NA_1

#### File transfer

(station-specific parameter, mark each Type ID 'X' if it is only used in the standard direction, 'R' if only used in the reverse direction, and 'B' if used in both directions)

<input type="checkbox"/>	<120>	:= File ready	F_FR_NA_1
<input type="checkbox"/>	<121>	:= Section ready	F_SR_NA_1
<input type="checkbox"/>	<122>	:= Call directory, select file, call file, call section	F_SC_NA_1
<input type="checkbox"/>	<123>	:= Last section, last segment	F_LS_NA_1
<input type="checkbox"/>	<124>	:= Ack file, ack section	F_AF_NA_1
<input type="checkbox"/>	<125>	:= Segment	F_SG_NA_1



- <126> := Directory {blank or X, only available in monitor (standard) direction} F\_DR\_TA\_1
- <127> := Query Log – Request archive file F\_SC\_NB\_1

**Type identification and cause of transmission assignments**  
(station-specific parameters)

Shaded boxes are not required.  
Blank = function or ASDU is not used.  
Mark type identification/cause of transmission combinations:  
"X" if used only in the standard direction;  
"R" if used only in the reverse direction;  
"B" if used in both directions.

**Type Identification**

		Cause of Transmission																		
		Periodic, cyclic	Background scan	Spontaneous	Initialized	Request or requested	Activation	Activation confirmation	Deactivation	Deactivation confirmation	Activation termination	Return info caused by a remote cmd	Return info caused by a local cmd	File transfer	Interrogated by group <number>	Request by group <n> counter request	Unknown type identification	Unknown cause of transmission	Unknown common address of ASDU	Unknown information object address
		1	2	3	4	5	6	7	8	9	10	11	12	13	20-36	37-41	44	45	46	47
<1>	M_SP_NA_1			X		X						X	X		X					
<2>	M_SP_TA_1														X					
<3>	M_DP_NA_1			X		X						X	X		X					
<4>	M_DP_TA_1																			
<5>	M_ST_NA_1			X		X						X	X		X					
<6>	M_ST_TA_1																			
<7>	M_BO_NA_1			X		X									X					
<8>	M_BO_TA_1																			
<9>	C_ME_NA_1			X		X									X					
<10>	M_ME_TA_1																			
<11>	M_ME_NB_1			X		X									X					
<12>	M_ME_TB_1																			



	TA_1																	
<59>	C_DC_TA_1																	
<60>	C_RC_TA_1																	
<61>	C_SE_TA_1																	
<62>	C_SE_TB_1																	
<63>	C_SE_TC_1																	
<64>	C_BO_TA_1																	
<70>	M_EI_NA_1*																	
<100>	C_IC_NA_1					X												
<101>	C_CI_NA_1					X												
<102>	C_RD_NA_1				X													
<103>	C_CS_NA_1					X												
<104>	C_TS_NA_1																	
<105>	C_RP_NA_1																	
<106>	C_CD_NA_1																	
<107>	C_TS_TA_1					X												
<110>	M_ME_NA_1																	
<111>	M_ME_NB_1																	
<112>	P_ME_NC_1																	
<113>	P_AC_NA_1																	
<120>	F_FR_NA_1																	
<121>	F_SR_NA_1																	
<122>	F_SC_NA_1																	
<123>	F_LS_NA_1																	
<124>	F_AF_NA_1																	
<125>	F_SG_NA_1																	
<126>	F_DR_TA_1*																	
<127>	F_SC_NB_1*																	

\* **Note:** Blank or X only.

## Basic Application Functions

### Station initialization

(station-specific parameter, mark with an "X" if function is used)

Remote initialization

### Cyclic data transmission

(station-specific parameter, mark with an "X" if function is used only in the standard direction, "R" if used only in the reverse direction, and "B" if used in both directions)

Cyclic data transmission

### Read procedure

(station-specific parameter, mark with an "X" if function is used only in the standard direction, "R" if used only in the reverse direction, and "B" if used in both directions)

Read procedure

### Spontaneous transmission

(station-specific parameter, mark with an "X" if function is used only in the standard direction, "R" if used only in the reverse direction, and "B" if used in both directions)

Spontaneous transmission

### Double transmission of information objects with cause of transmission spontaneous

(station-specific parameter, mark each information type with an "X" where both a type ID without time and corresponding type ID with time are issued in response to a single spontaneous change of a monitored object) The following type identifications may be transmitted in succession caused by a single status change of an information object. The particular information object addresses for which double transmission is enabled are defined in a project-specific list.

<input type="checkbox"/>	Single-point information	M_SP_NA_1, M_SP_TA_1, M_SP_TB_1, M_PS_NA_1
<input type="checkbox"/>	Double-point information	M_DP_NA_1, M_DP_TA_1, M_DP_TB_1
<input type="checkbox"/>	Step position information	M_ST_NA_1, M_ST_TA_1, M_ST_TB_1
<input type="checkbox"/>	Bitstring of 32 bit	M_BO_NA_1, M_BO_TA_1, M_BO_TB_1*
<input type="checkbox"/>	Measured value, normalized value	M_ME_NA_1, M_ME_TA_1, M_ME_ND_1, M_ME_TD_1
<input type="checkbox"/>	Measured value, scaled value	M_ME_NB_1, M_ME_TB_1, M_ME_TE_1
<input type="checkbox"/>	Measured value, short floating point number	M_ME_NC_1, M_ME_TC_1, M_ME_TF_1

\***Note:** If defined for a specific project.

### Station interrogation

(station-specific parameter, mark each Type ID "X" if it is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions)

<input checked="" type="checkbox"/>	global		
<input type="checkbox"/>	group 1	<input type="checkbox"/>	group 7
<input type="checkbox"/>	group 2	<input type="checkbox"/>	group 8
<input type="checkbox"/>	group 3	<input type="checkbox"/>	group 9
<input type="checkbox"/>	group 4	<input type="checkbox"/>	group 10
<input type="checkbox"/>	group 5	<input type="checkbox"/>	group 11
<input type="checkbox"/>	group 6	<input type="checkbox"/>	group 12
		<input type="checkbox"/>	group 13
		<input type="checkbox"/>	group 14
		<input type="checkbox"/>	group 15
		<input type="checkbox"/>	group 16

**Note:** Information Object Addresses assigned to each group must be shown in a separate table.

#### Clock synchronization

(station-specific parameter, mark each Type ID "X" if it is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions)

- Clock synchronization
- Day of week used
- RES1, GEN (time tag substituted/ not substituted) used
- SU-bit (summertime) used

**Note:** optional, see clause 7.6.

#### Command transmission

(object-specific parameter, mark with an "X" if function is used only in the standard direction, "R" if used only in the reverse direction, and "B" if used in both directions)

- Direct command transmission
- Direct set point command transmission
- Select and execute command
- Select and execute set point command
- C\_SE\_ACTTERM used
- No additional definition
- Short pulse duration (duration determined by a system parameter in the outstation)
- Long pulse duration (duration determined by a system parameter in the outstation)
- Persistent output
- Supervision of maximum delay in command direction of commands and set point commands

**Configurable** Maximum allowable delay of commands and set point commands

#### Transmission of integrated tools

(station-specific parameter, mark "X" if function is only used in the standard direction, "R" if only used in the reverse direction, and "B" if used in both directions)

- Mode A: Local freeze with spontaneous
- Mode B: Local freeze with counter
- Mode C Freeze and transmit by counter interrogation
- Mode C Freeze by counter-interrogation command, frozen values reported
- Counter read
- Counter freeze without reset
- Counter freeze with reset
- Counter reset
- General request counter
- Request counter group 1
- Request counter group 2
- Request counter group 3
- Request counter group 4

#### Parameter loading

(object-specific parameter, mark with an "X" if function is used only in the standard direction, "R" if used only in the reverse direction, and "B" if used in both directions)

- Threshold value
- Smoothing factor
- Low limit for transmission of measured value
- High limit for transmission of measured value

**Parameter activation**

(object-specific parameter, mark with an "X" if function is used only in the standard direction, "R" if used only in the reverse direction, and "B" if used in both directions)

- Activation / deactivation of persistent cyclic or periodic transmission of the addressed object

**Test procedure**

(station-specific parameter, mark with an "X" if function is used only in the standard direction, "R" if used only in the reverse direction, and "B" if used in both directions)

- Test procedure

**File transfer**

(station-specific parameter, mark with an "X" if function is used)

File transfer in monitor direction

- Transparent file
- Transmission of disturbance data of protection
- Transmission of sequences of events
- Transmission of sequences of recorded analog values

File transfer in control direction

- Transparent file

**Background scan**

(station-specific parameter, mark with an "X" if function is used only in the standard direction, "R" if used only in the reverse direction, and "B" if used in both directions)

- Background scan

**Acquisition of transmission delay**

(station-specific parameter, mark with an "X" if function is used only in the standard direction, "R" if used only in the reverse direction, and "B" if used in both directions)

- Acquisition of transmission delay

**Definition of time-outs**

Parameter	Default Value	Remarks	Selected Value
$t_0$	30s	Time-out of connection establishment	Configurable
$t_1$	15s	Time-out of send or test APDUs	Configurable
$t_2$	10s	Time-out for acknowledges in case of no data messages $t_2 < t_1$	Configurable
$t_3$	20s	Time-out for sending test frames in case of a long idle state	Configurable

Maximum range of values for all time outs: 1 to 255 seconds, accuracy 1 seconds.

**Maximum number of outstanding I format APDUs k and latest acknowledge APDUs (w)**

Parameter	Default Value	Remarks	Selected Value
k	12 APDUs	Maximum difference receive sequence number to send state variable	<b>Configurable</b>
w	8 APDUs	Latest acknowledge after receiving w I-format APDUs	<b>Configurable</b>

Maximum range of values k: 1 to 32767 ( $2^{15}-1$ ) APDUs, accuracy 1 APDU.  
 Maximum range of values w: 1 to 32767 APDUs, accuracy 1 APDU (Recommendation: w should not exceed two-thirds of k).

**Port number**

Parameter	Value	Remarks
Portnumber	2404	In all cases

**Redundant connections**

**Configurable** Number N of redundancy ground connections used

**RFC 2200 suit**

RFC 2200 is an official Internet Standard which describes the state of standardization of protocols used in the Internet as determined by the Internet Architecture Board (IAB). It offers a broad spectrum of actual standards used in the Internet. The suitable selection of documents from RFC 2200 defined in this standard for given projects has to be chosen by the user of this standard.

- Ethernet 802.3
- Serial X.21 interface
- Other selection from RFC 2200:

List of valid documents from RFC 2200:

1. ....
2. ....
3. ....
4. ....
5. ....
6. ....
7. ....

etc.

# Index

## A

Acquisition of transmission delay 30  
Address Descriptions 11  
Address field of link 21  
Address Settings 5  
ASDU 20

## B

Background scan 30  
Boolean 10  
Buffer Size 5  
Buffered, Monitor ASDUs 13  
Byte 10

## C

Cause of transmission 22  
Cause of Transmission 12  
Channel Setup 4  
Char 10  
Clock synchronization 29  
COMMAND 15  
Command Based 15  
Command transmission 29  
Common Address 7  
Common address of ASDU 22  
Communications 7  
Connect Timeout 4  
Control ASDUs 14  
COT 12  
Counter Interrogation 8  
Cyclic data transmission 28

## D

Data Types Description 10  
Date 10  
Destination Host 4  
Destination Port 4  
Device <device name> failed to complete clock synchronization. 16



Device <device name> failed to complete counter interrogation. 16  
Device <device name> failed to complete general interrogation. 16  
Device <device name> is not responding. 17  
Device Setup 6  
Double transmission 28  
DWord 10

## E

Error Descriptions 16  
Error loading XML file for device. Common Address is already used. 17  
Error loading XML file for device. Common Address is invalid. Valid range is low limit to high limit. 17  
Event Playback 9

## F

File transfer 24  
Float 10  
Frame length 21

## G

General Interrogation 8

## H

Help Contents 3

## I

IEC 60870-5-104 Interoperability Guide 20  
Incremental Timeout 5  
Information object address 22  
Information Object Address (IOA) 11  
Initialization Settings 8  
Interrogation Attempt Count 8  
Interrogation Request Timeout 8

## L

Length of APDU 22  
Link Settings 5

Link transmission procedure 21  
Long 10

**M**

Master 20  
Messages 16  
Monitor ASDUs 11

**O**

OPTIONAL 14  
Originator Address 5  
Overview 3

**P**

Parameter 24  
Parameter activation 30  
Parameter loading 29  
Playback Buffer Size 9  
Playback Rate 9  
Polled Reads 8  
Process information 22  
Protocol 6

**R**

Read failed on tag due to data type mismatch. 18  
Read failed on tag. 17  
Read procedure 28

**S**

Settings 4  
Short 10  
Slave 20  
Spontaneous transmission 28  
Standard ASDUs 22  
Station initialization 28  
Station interrogation 28  
SUBTYPE 11, 14  
System information 24

**T**

Test procedure 30

Timing 7

Timing Settings 5

Too many events received in device name, the buffer has overflowed. 18

Transmission of integrated tools 29

Transmission speed 20

Type identification 21

TYPEID 11

**U**

Unable to write to address <address> on device <device>. 18

Unbuffered, Monitor ASDUs 13

**W**

Word 10

Write failed on <tag name>. 19

