

Thermo Westronics Ethernet Driver

© 2023 PTC Inc. All Rights Reserved.

Table of Contents

Thermo Westronics Ethernet Driver	1
Table of Contents	2
Thermo Westronics Ethernet Driver	4
Overview	4
Setup	4
Channel Properties — General	5
Tag Counts	6
Channel Properties — Ethernet Communications	7
Channel Properties — Write Optimizations	7
Channel Properties — Advanced	8
Device Properties — General	9
Operating Mode	10
Tag Counts	10
Device Properties — Scan Mode	10
Device Properties — Timing	11
Device Properties — Auto-Demotion	12
Device Properties — Tag Generation	13
Device Properties — TCP/IP	16
Device Properties — Blocks	16
Device Properties — Settings	17
Device Properties — Redundancy	17
Optimizing Communications	18
Data Types Description	19
Address Descriptions	20
SV100 Addressing	20
SV180 Addressing	22
SV180 (2.0) Addressing	24
Error Descriptions	25
Missing address	25
Device address <address> contains a syntax error	25
Address <address> is out of range for the specified device or register	25
Device address <address> is not supported by model <model name>	26
Data Type <type> is not valid for device address <address>	26
Device address <address> is Read Only	26
Array size is out of range for address <address>	26
Array support is not available for the specified address: <address>	27

Device <device name> is not responding	27
Unable to write to <address> on device <device name>	27
Failure to initiate 'Winsock.dll'	28
Bad address in block [<start address> to <end address>] on device <device name>	28
Index	29

Thermo Westronics Ethernet Driver

Help version 1.018

CONTENTS

Overview

What is the Thermo Westronics Ethernet Driver?

Setup

How do I configure a device for use with this driver?

Optimizing Communications

How do I get the best performance from this driver?

Data Types Description

What data types does this driver support?

Address Descriptions

How do I address a data location on a Thermo Westronics Ethernet device?

Error Descriptions

What error messages does the Thermo Westronics Ethernet Driver produce?

Overview

The Thermo Westronics Ethernet Driver provides a reliable way to connect Thermo Westronics Ethernet devices to OPC Client applications, including HMI, SCADA, Historian, MES, ERP and countless custom applications. It is intended for use with Thermo Westronics Ethernet devices.

Setup

Supported Devices

SV 100

SV 180

SV 180 (2.0) - version 2.0A or later

Communication Protocol

Modbus Ethernet

Channel and Device Limits

The maximum number of channels supported by this driver is 100. The maximum number of devices supported by this driver is 8192 per channel.

Device IDs are specified as YYY.YYY.YYY.YYY.XXX, where YYY designates the device IP address and XXX designates the destination device unit number. Each YYY byte should be in the range of 0 to 255.

Channel Properties — General

This server supports the use of multiple simultaneous communications drivers. Each protocol or driver used in a server project is called a channel. A server project may consist of many channels with the same communications driver or with unique communications drivers. A channel acts as the basic building block of an OPC link. This group is used to specify general channel properties, such as the identification attributes and operating mode.

Property Groups General Write Optimizations Advanced	<table border="1"> <tr> <td colspan="2">[-] Identification</td> </tr> <tr> <td>Name</td> <td></td> </tr> <tr> <td>Description</td> <td></td> </tr> <tr> <td>Driver</td> <td></td> </tr> <tr> <td colspan="2">[-] Diagnostics</td> </tr> <tr> <td>Diagnostics Capture</td> <td>Disable</td> </tr> <tr> <td colspan="2">[-] Tag Counts</td> </tr> <tr> <td>Static Tags</td> <td>10</td> </tr> </table>	[-] Identification		Name		Description		Driver		[-] Diagnostics		Diagnostics Capture	Disable	[-] Tag Counts		Static Tags	10
[-] Identification																	
Name																	
Description																	
Driver																	
[-] Diagnostics																	
Diagnostics Capture	Disable																
[-] Tag Counts																	
Static Tags	10																

Identification

Name: Specify the user-defined identity of this channel. In each server project, each channel name must be unique. Although names can be up to 256 characters, some client applications have a limited display window when browsing the OPC server's tag space. The channel name is part of the OPC browser information. The property is required for creating a channel.

• For information on reserved characters, refer to "How To... Properly Name a Channel, Device, Tag, and Tag Group" in the server help.

Description: Specify user-defined information about this channel.

• Many of these properties, including Description, have an associated system tag.

Driver: Specify the protocol / driver for this channel. Specify the device driver that was selected during channel creation. It is a disabled setting in the channel properties. The property is required for creating a channel.

• **Note:** With the server's online full-time operation, these properties can be changed at any time. This includes changing the channel name to prevent clients from registering data with the server. If a client has already acquired an item from the server before the channel name is changed, the items are unaffected. If, after the channel name has been changed, the client application releases the item and attempts to re-acquire using the old channel name, the item is not accepted. Changes to the properties should not be made once a large client application has been developed. Utilize proper user role and privilege management to prevent operators from changing properties or accessing server features.

Diagnostics

Diagnostics Capture: When enabled, this option makes the channel's diagnostic information available to OPC applications allows the usage of statistics tags that provide feedback to client applications regarding the operation of the channel. Because the server's diagnostic features require a minimal amount of overhead processing, it is recommended that they be utilized when needed and disabled when not. The default is disabled.

• **Note:** This property is not available if the driver does not support diagnostics.

• For more information, refer to "Communication Diagnostics" and "Statistics Tags" in the server help.

Tag Counts

Static Tags: Provides the total number of defined static tags at this level (device or channel). This information can be helpful in troubleshooting and load balancing.

Channel Properties — Ethernet Communications

Ethernet Communication can be used to communicate with devices.

Property Groups	Ethernet Settings	
General	Network Adapter	Default
Ethernet Communications		
Write Optimizations		
Advanced		

Ethernet Settings

Network Adapter: Specify the network adapter to bind. When left blank or Default is selected, the operating system selects the default adapter.

Channel Properties — Write Optimizations

The server must ensure that the data written from the client application gets to the device on time. Given this goal, the server provides optimization properties to meet specific needs or improve application responsiveness.

Property Groups	Write Optimizations	
General	Optimization Method	Write Only Latest Value for All Tags
Write Optimizations	Duty Cycle	10

Write Optimizations

Optimization Method: Controls how write data is passed to the underlying communications driver. The options are:

- **Write All Values for All Tags:** This option forces the server to attempt to write every value to the controller. In this mode, the server continues to gather write requests and add them to the server's internal write queue. The server processes the write queue and attempts to empty it by writing data to the device as quickly as possible. This mode ensures that everything written from the client applications is sent to the target device. This mode should be selected if the write operation order or the write item's content must uniquely be seen at the target device.
- **Write Only Latest Value for Non-Boolean Tags:** Many consecutive writes to the same value can accumulate in the write queue due to the time required to actually send the data to the device. If the server updates a write value that has already been placed in the write queue, far fewer writes are needed to reach the same final output value. In this way, no extra writes accumulate in the server's queue. When the user stops moving the slide switch, the value in the device is at the correct value at virtually the same time. As the mode states, any value that is not a Boolean value is updated in the server's internal write queue and sent to the device at the next possible opportunity. This can greatly improve the application performance.
 - **Note:** This option does not attempt to optimize writes to Boolean values. It allows users to optimize the operation of HMI data without causing problems with Boolean operations, such as a momentary push button.
- **Write Only Latest Value for All Tags:** This option takes the theory behind the second optimization mode and applies it to all tags. It is especially useful if the application only needs to send the latest

value to the device. This mode optimizes all writes by updating the tags currently in the write queue before they are sent. This is the default mode.

Duty Cycle: is used to control the ratio of write to read operations. The ratio is always based on one read for every one to ten writes. The duty cycle is set to ten by default, meaning that ten writes occur for each read operation. Although the application is performing a large number of continuous writes, it must be ensured that read data is still given time to process. A setting of one results in one read operation for every write operation. If there are no write operations to perform, reads are processed continuously. This allows optimization for applications with continuous writes versus a more balanced back and forth data flow.

● **Note:** It is recommended that the application be characterized for compatibility with the write optimization enhancements before being used in a production environment.

Channel Properties — Advanced

This group is used to specify advanced channel properties. Not all drivers support all properties; so the Advanced group does not appear for those devices.

Property Groups	<input type="checkbox"/> Non-Normalized Float Handling	
General	Floating-Point Values	Replace with Zero
Write Optimizations	<input type="checkbox"/> Inter-Device Delay	
Advanced	Inter-Device Delay (ms)	0

Non-Normalized Float Handling: A non-normalized value is defined as Infinity, Not-a-Number (NaN), or as a Denormalized Number. The default is Replace with Zero. Drivers that have native float handling may default to Unmodified. Non-normalized float handling allows users to specify how a driver handles non-normalized IEEE-754 floating point data. Descriptions of the options are as follows:

- **Replace with Zero:** This option allows a driver to replace non-normalized IEEE-754 floating point values with zero before being transferred to clients.
- **Unmodified:** This option allows a driver to transfer IEEE-754 denormalized, normalized, non-number, and infinity values to clients without any conversion or changes.

● **Note:** This property is disabled if the driver does not support floating-point values or if it only supports the option that is displayed. According to the channel's float normalization setting, only real-time driver tags (such as values and arrays) are subject to float normalization. For example, EFM data is not affected by this setting.

● *For more information on the floating-point values, refer to "How To ... Work with Non-Normalized Floating-Point Values" in the server help.*

Inter-Device Delay: Specify the amount of time the communications channel waits to send new requests to the next device after data is received from the current device on the same channel. Zero (0) disables the delay.

● **Note:** This property is not available for all drivers, models, and dependent settings.

Device Properties — General

A device represents a single target on a communications channel. If the driver supports multiple controllers, users must enter a device ID for each controller.

Property Groups	Identification	
General	Name	
Scan Mode	Description	
	Channel Assignment	
	Driver	
	Model	
	ID Format	Decimal
	ID	2

Identification

Name: Specify the name of the device. It is a logical user-defined name that can be up to 256 characters long and may be used on multiple channels.

Note: Although descriptive names are generally a good idea, some OPC client applications may have a limited display window when browsing the OPC server's tag space. The device name and channel name become part of the browse tree information as well. Within an OPC client, the combination of channel name and device name would appear as "ChannelName.DeviceName".

For more information, refer to "How To... Properly Name a Channel, Device, Tag, and Tag Group" in server help.

Description: Specify the user-defined information about this device.

Many of these properties, including Description, have an associated system tag.

Channel Assignment: Specify the user-defined name of the channel to which this device currently belongs.

Driver: Selected protocol driver for this device.

Model: Specify the type of device that is associated with this ID. The contents of the drop-down menu depend on the type of communications driver being used. Models that are not supported by a driver are disabled. If the communications driver supports multiple device models, the model selection can only be changed when there are no client applications connected to the device.

Note: If the communication driver supports multiple models, users should try to match the model selection to the physical device. If the device is not represented in the drop-down menu, select a model that conforms closest to the target device. Some drivers support a model selection called "Open," which allows users to communicate without knowing the specific details of the target device. For more information, refer to the driver help documentation.

ID: Specify the device's driver-specific station or node. The type of ID entered depends on the communications driver being used. For many communication drivers, the ID is a numeric value. Drivers that support a Numeric ID provide users with the option to enter a numeric value whose format can be changed to suit the needs of the application or the characteristics of the selected communications driver. The format is set by the driver by default. Options include Decimal, Octal, and Hexadecimal.

Note: If the driver is Ethernet-based or supports an unconventional station or node name, the device's TCP/IP address may be used as the device ID. TCP/IP addresses consist of four values that are separated by periods, with each value in the range of 0 to 255. Some device IDs are string based. There may be additional properties to configure within the ID field, depending on the driver.

Operating Mode

Property Groups	+ Identification	
General	- Operating Mode	
Scan Mode	Data Collection	Enable
	Simulated	No

Data Collection: This property controls the device's active state. Although device communications are enabled by default, this property can be used to disable a physical device. Communications are not attempted when a device is disabled. From a client standpoint, the data is marked as invalid and write operations are not accepted. This property can be changed at any time through this property or the device system tags.

Simulated: Place the device into or out of Simulation Mode. In this mode, the driver does not attempt to communicate with the physical device, but the server continues to return valid OPC data. Simulated stops physical communications with the device, but allows OPC data to be returned to the OPC client as valid data. While in Simulation Mode, the server treats all device data as reflective: whatever is written to the simulated device is read back and each OPC item is treated individually. The data is not saved if the server removes the item (such as when the server is reinitialized). The default is No.

Notes:

1. This System tag (`_Simulated`) is read only and cannot be written to for runtime protection. The System tag allows this property to be monitored from the client.
2. When a device is simulated, updates may not appear faster than one (1) second client.

Simulation Mode is for test and simulation purposes only. It should never be used in a production environment.

Tag Counts

Property Groups	- Identification	
General	- Operating Mode	
	- Tag Counts	
	Static Tags	130

Static Tags: Provides the total number of defined static tags at this level (device or channel). This information can be helpful in troubleshooting and load balancing.

Device Properties — Scan Mode

The Scan Mode specifies the subscribed-client requested scan rate for tags that require device communications. Synchronous and asynchronous device reads and writes are processed as soon as possible; unaffected by the Scan Mode properties.

Property Groups	- Scan Mode	
General	Scan Mode	Respect Client-Specified Scan Rate ▼
Scan Mode	Initial Updates from Cache	Disable

Scan Mode: Specify how tags in the device are scanned for updates sent to subscribing clients. Descriptions of the options are:

- **Respect Client-Specified Scan Rate:** This mode uses the scan rate requested by the client.
- **Request Data No Faster than Scan Rate:** This mode specifies the value set as the maximum scan rate. The valid range is 10 to 99999990 milliseconds. The default is 1000 milliseconds.
 - **Note:** When the server has an active client and items for the device and the scan rate value is increased, the changes take effect immediately. When the scan rate value is decreased, the changes do not take effect until all client applications have been disconnected.
- **Request All Data at Scan Rate:** This mode forces tags to be scanned at the specified rate for subscribed clients. The valid range is 10 to 99999990 milliseconds. The default is 1000 milliseconds.
- **Do Not Scan, Demand Poll Only:** This mode does not periodically poll tags that belong to the device nor perform a read to get an item's initial value once it becomes active. It is the OPC client's responsibility to poll for updates, either by writing to the `_DemandPoll` tag or by issuing explicit device reads for individual items. *For more information, refer to "Device Demand Poll" in server help.*
- **Respect Tag-Specified Scan Rate:** This mode forces static tags to be scanned at the rate specified in their static configuration tag properties. Dynamic tags are scanned at the client-specified scan rate.

Initial Updates from Cache: When enabled, this option allows the server to provide the first updates for newly activated tag references from stored (cached) data. Cache updates can only be provided when the new item reference shares the same address, scan rate, data type, client access, and scaling properties. A device read is used for the initial update for the first client reference only. The default is disabled; any time a client activates a tag reference the server attempts to read the initial value from the device.

Device Properties — Timing

The device Timing properties allow the driver's response to error conditions to be tailored to fit the application's needs. In many cases, the environment requires changes to these properties for optimum performance. Factors such as electrically generated noise, modem delays, and poor physical connections can influence how many errors or timeouts a communications driver encounters. Timing properties are specific to each configured device.

Property Groups General Scan Mode Timing	<table border="1"> <tr> <td colspan="2">Communication Timeouts</td> </tr> <tr> <td>Connect Timeout (s)</td> <td>3</td> </tr> <tr> <td>Request Timeout (ms)</td> <td>1000</td> </tr> <tr> <td>Attempts Before Timeout</td> <td>3</td> </tr> </table>	Communication Timeouts		Connect Timeout (s)	3	Request Timeout (ms)	1000	Attempts Before Timeout	3
Communication Timeouts									
Connect Timeout (s)	3								
Request Timeout (ms)	1000								
Attempts Before Timeout	3								

Communications Timeouts

Connect Timeout: This property (which is used primarily by Ethernet based drivers) controls the amount of time required to establish a socket connection to a remote device. The device's connection time often takes longer than normal communications requests to that same device. The valid range is 1 to 30 seconds. The default is typically 3 seconds, but can vary depending on the driver's specific nature. If this setting is not supported by the driver, it is disabled.

● **Note:** Due to the nature of UDP connections, the connection timeout setting is not applicable when communicating via UDP.

Request Timeout: Specify an interval used by all drivers to determine how long the driver waits for a response from the target device to complete. The valid range is 50 to 9999 milliseconds (167 minutes). The default is usually 1000 milliseconds, but can vary depending on the driver. The default timeout for most

serial drivers is based on a baud rate of 9600 baud or better. When using a driver at lower baud rates, increase the timeout to compensate for the increased time required to acquire data.

Attempts Before Timeout: Specify how many times the driver issues a communications request before considering the request to have failed and the device to be in error. The valid range is 1 to 10. The default is typically 3, but can vary depending on the driver's specific nature. The number of attempts configured for an application depends largely on the communications environment. This property applies to both connection attempts and request attempts.

Timing

Inter-Request Delay: Specify how long the driver waits before sending the next request to the target device. It overrides the normal polling frequency of tags associated with the device, as well as one-time reads and writes. This delay can be useful when dealing with devices with slow turnaround times and in cases where network load is a concern. Configuring a delay for a device affects communications with all other devices on the channel. It is recommended that users separate any device that requires an inter-request delay to a separate channel if possible. Other communications properties (such as communication serialization) can extend this delay. The valid range is 0 to 300,000 milliseconds; however, some drivers may limit the maximum value due to a function of their particular design. The default is 0, which indicates no delay between requests with the target device.

Note: Not all drivers support Inter-Request Delay. This setting does not appear if it is not available.

Property Groups General Scan Mode Timing	[-] Timing	
	Inter-Request Delay (ms)	0

Device Properties — Auto-Demotion

The Auto-Demotion properties can temporarily place a device off-scan in the event that a device is not responding. By placing a non-responsive device offline for a specific time period, the driver can continue to optimize its communications with other devices on the same channel. After the time period has been reached, the driver re-attempts to communicate with the non-responsive device. If the device is responsive, the device is placed on-scan; otherwise, it restarts its off-scan time period.

Property Groups General Scan Mode Timing Auto-Demotion	[-] Auto-Demotion	
	Demote on Failure	Enable ▾
	Timeouts to Demote	3
	Demotion Period (ms)	10000
	Discard Requests when Demoted	Disable

Demote on Failure: When enabled, the device is automatically taken off-scan until it is responding again.

Tip: Determine when a device is off-scan by monitoring its demoted state using the `_AutoDemoted` system tag.

Timeouts to Demote: Specify how many successive cycles of request timeouts and retries occur before the device is placed off-scan. The valid range is 1 to 30 successive failures. The default is 3.

Demotion Period: Indicate how long the device should be placed off-scan when the timeouts value is reached. During this period, no read requests are sent to the device and all data associated with the read

requests are set to bad quality. When this period expires, the driver places the device on-scan and allows for another attempt at communications. The valid range is 100 to 3600000 milliseconds. The default is 10000 milliseconds.

Discard Requests when Demoted: Select whether or not write requests should be attempted during the off-scan period. Disable to always send write requests regardless of the demotion period. Enable to discard writes; the server automatically fails any write request received from a client and does not post a message to the Event Log.

Device Properties — Tag Generation

The automatic tag database generation features make setting up an application a plug-and-play operation. Select communications drivers can be configured to automatically build a list of tags that correspond to device-specific data. These automatically generated tags (which depend on the nature of the supporting driver) can be browsed from the clients.

Not all devices and drivers support full automatic tag database generation and not all support the same data types. Consult the data types descriptions or the supported data type lists for each driver for specifics.

If the target device supports its own local tag database, the driver reads the device's tag information and uses the data to generate tags within the server. If the device does not natively support named tags, the driver creates a list of tags based on driver-specific information. An example of these two conditions is as follows:

1. If a data acquisition system supports its own local tag database, the communications driver uses the tag names found in the device to build the server's tags.
2. If an Ethernet I/O system supports detection of its own available I/O module types, the communications driver automatically generates tags in the server that are based on the types of I/O modules plugged into the Ethernet I/O rack.

Note: Automatic tag database generation's mode of operation is completely configurable. *For more information, refer to the property descriptions below.*

<p>Property Groups</p> <ul style="list-style-type: none"> General Scan Mode Timing Auto-Demotion Tag Generation Communications Redundancy 	<p><input type="checkbox"/> Tag Generation</p> <table border="1"> <tr> <td>On Device Startup</td> <td>Do Not Generate on Startup</td> </tr> <tr> <td>On Duplicate Tag</td> <td>Delete on Create</td> </tr> <tr> <td>Parent Group</td> <td></td> </tr> <tr> <td>Allow Automatically Generated Subgroups</td> <td>Enable</td> </tr> <tr> <td>Create</td> <td>Create tags</td> </tr> </table>	On Device Startup	Do Not Generate on Startup	On Duplicate Tag	Delete on Create	Parent Group		Allow Automatically Generated Subgroups	Enable	Create	Create tags
On Device Startup	Do Not Generate on Startup										
On Duplicate Tag	Delete on Create										
Parent Group											
Allow Automatically Generated Subgroups	Enable										
Create	Create tags										

On Property Change: If the device supports automatic tag generation when certain properties change, the **On Property Change** option is shown. It is set to **Yes** by default, but it can be set to **No** to control over when tag generation is performed. In this case, the **Create tags** action must be manually invoked to perform tag generation. To invoke via the Configuration API service, access /config/v1/project/channels/{name}/devices/{name}/services/TagGeneration.

On Device Startup: Specify when OPC tags are automatically generated. Descriptions of the options are as follows:

- **Do Not Generate on Startup:** This option prevents the driver from adding any OPC tags to the tag space of the server. This is the default setting.
- **Always Generate on Startup:** This option causes the driver to evaluate the device for tag information. It also adds tags to the tag space of the server every time the server is launched.
- **Generate on First Startup:** This option causes the driver to evaluate the target device for tag information the first time the project is run. It also adds any OPC tags to the server tag space as needed.

● **Note:** When the option to automatically generate OPC tags is selected, any tags that are added to the server's tag space must be saved with the project. Users can configure the project to automatically save from the **Tools | Options** menu.

On Duplicate Tag: When automatic tag database generation is enabled, the server needs to know what to do with the tags that it may have previously added or with tags that have been added or modified after the communications driver since their original creation. This setting controls how the server handles OPC tags that were automatically generated and currently exist in the project. It also prevents automatically generated tags from accumulating in the server.

For example, if a user changes the I/O modules in the rack with the server configured to **Always Generate on Startup**, new tags would be added to the server every time the communications driver detected a new I/O module. If the old tags were not removed, many unused tags could accumulate in the server's tag space. The options are:

- **Delete on Create:** This option deletes any tags that were previously added to the tag space before any new tags are added. This is the default setting.
- **Overwrite as Necessary:** This option instructs the server to only remove the tags that the communications driver is replacing with new tags. Any tags that are not being overwritten remain in the server's tag space.
- **Do not Overwrite:** This option prevents the server from removing any tags that were previously generated or already existed in the server. The communications driver can only add tags that are completely new.
- **Do not Overwrite, Log Error:** This option has the same effect as the prior option, and also posts an error message to the server's Event Log when a tag overwrite would have occurred.

● **Note:** Removing OPC tags affects tags that have been automatically generated by the communications driver as well as any tags that have been added using names that match generated tags. Users should avoid adding tags to the server using names that may match tags that are automatically generated by the driver.

Parent Group: This property keeps automatically generated tags from mixing with tags that have been entered manually by specifying a group to be used for automatically generated tags. The name of the group can be up to 256 characters. This parent group provides a root branch to which all automatically generated tags are added.

Allow Automatically Generated Subgroups: This property controls whether the server automatically creates subgroups for the automatically generated tags. This is the default setting. If disabled, the server generates the device's tags in a flat list without any grouping. In the server project, the resulting tags are named with the address value. For example, the tag names are not retained during the generation process.

● **Note:** If, as the server is generating tags, a tag is assigned the same name as an existing tag, the system automatically increments to the next highest number so that the tag name is not duplicated. For example, if the generation process creates a tag named "AI22" that already exists, it creates the tag as "AI23" instead.

Create: Initiates the creation of automatically generated OPC tags. If the device's configuration has been modified, **Create tags** forces the driver to reevaluate the device for possible tag changes. Its ability to be accessed from the System tags allows a client application to initiate tag database creation.

● **Note:** **Create tags** is disabled if the Configuration edits a project offline.

Device Properties — TCP/IP

Property Groups	<input type="checkbox"/> Port Number	
General	Port	502
Scan Mode		
Timing		
Auto-Demotion		
Tag Generation		
TCP/IP		
Blocks		
Settings		
Redundancy		

Port Number

Port: Specifies the TCP/IP port number the remote device is configured to use. The default port number is 502.

Device Properties — Blocks

Property Groups	<input type="checkbox"/> Discretes	
General	Output Discretes	32
Scan Mode	Input Discretes	32
Timing	<input type="checkbox"/> Registers	
Auto-Demotion	Output Registers	32
TCP/IP	Input Registers	32
Blocks		

Coils

Input and output coils can be read from 8 to 800 points (bits) at a time.

Registers

Registers can be read from 1 to 56 locations (16 or 32-bit registers) at a time. The default block size should be changed if the device does not support block Read/Write operations. It should also be changed if the device contains non-contiguous addresses. If this is the case and the driver attempts to read a block of data that encompasses undefined memory, the device will most likely reject the request.

Device Properties — Settings

<p>Property Groups</p> <ul style="list-style-type: none"> General Scan Mode Timing Auto-Demotion Tag Generation TCP/IP Blocks <li style="background-color: #0070C0; color: white;">Settings Redundancy 	<p>Modbus Register Configuration</p> <table border="1"> <tr> <td>Use 1x32 Floating Point Format</td> <td>Enable</td> </tr> <tr> <td> </td> <td> </td> </tr> </table>	Use 1x32 Floating Point Format	Enable		
Use 1x32 Floating Point Format	Enable				

Modbus Register Configuration

Some Thermo Westronics devices, such as the SV100 and SV180, give users the option of representing floating point data in either 1x32 or 2x16 format in Modbus communications.

Use 1x32 Floating Point Format: Enable when the device has been configured to use the 1x32 format.

Device Properties — Redundancy

<p>Property Groups</p> <ul style="list-style-type: none"> General Scan Mode Timing Auto-Demotion Tag Generation Tag Import Settings <li style="background-color: #0070C0; color: white;">Redundancy 	<p>Redundancy</p> <table border="1"> <tr> <td>Secondary Path</td> <td>Channel.Device1 ...</td> </tr> <tr> <td>Operating Mode</td> <td>Switch On Failure</td> </tr> <tr> <td>Monitor Item</td> <td> </td> </tr> <tr> <td>Monitor Interval (s)</td> <td>300</td> </tr> <tr> <td>Return to Primary ASAP</td> <td>Yes</td> </tr> <tr> <td> </td> <td> </td> </tr> </table>	Secondary Path	Channel.Device1 ...	Operating Mode	Switch On Failure	Monitor Item		Monitor Interval (s)	300	Return to Primary ASAP	Yes		
Secondary Path	Channel.Device1 ...												
Operating Mode	Switch On Failure												
Monitor Item													
Monitor Interval (s)	300												
Return to Primary ASAP	Yes												


Redundancy is available with the Media-Level Redundancy Plug-In.

• Consult the website, a sales representative, or the [user manual](#) for more information.


Optimizing Communications

The Thermo Westronics Ethernet Driver has been designed to provide the best performance with the least amount of impact on the system's overall performance. While the Thermo Westronics Ethernet Driver is fast, there are a couple of guidelines that can be used to control and optimize the application and gain maximum performance.

This server refers to communications protocols like Thermo Westronics Ethernet as a channel. Each channel defined in the application represents a separate path of execution in the server. Once a channel has been defined, a series of devices must then be defined under that channel. Each of these devices represents a single Thermo Westronics Ethernet controller from which data will be collected. While this approach to defining the application will provide a high level of performance, it won't take full advantage of the Thermo Westronics Ethernet Driver or the network. An example of how the application may appear when configured using a single channel is shown below.

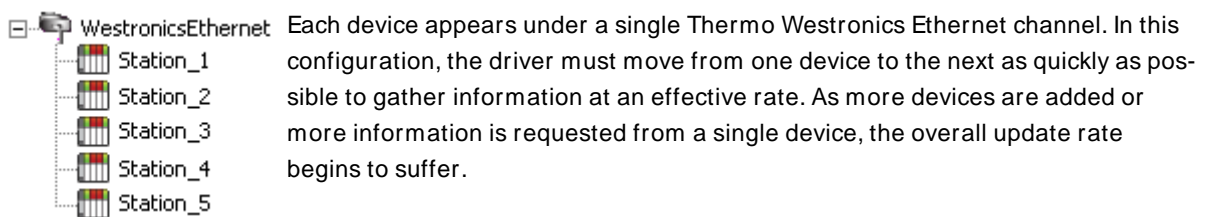

If the Thermo Westronics Ethernet Driver could only define one single channel, then the example shown above would be the only option available; however, the Thermo Westronics Ethernet Driver can define up to 100 channels. Using multiple channels distributes the data collection workload by simultaneously issuing multiple requests to the network. An example of how the same application may appear when configured using multiple channels to improve performance is shown below.

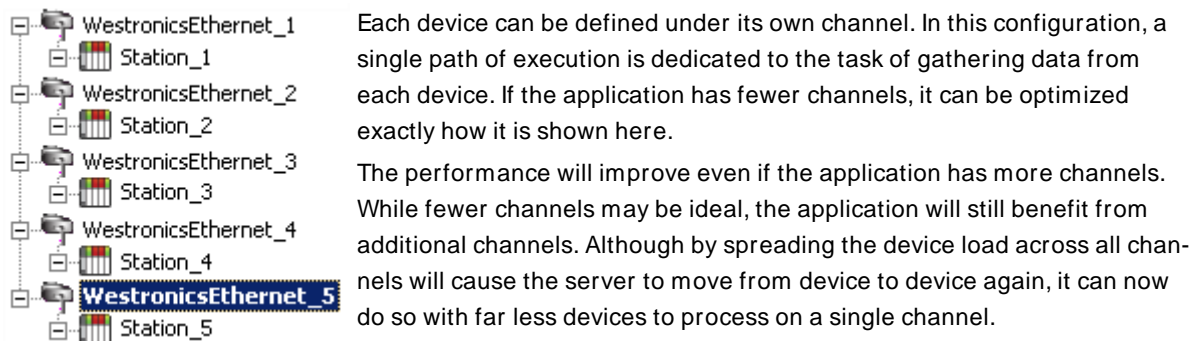

Block Size, which is available on each defined device, can also affect the Thermo Westronics Ethernet Driver performance. Block Size refers to the number of bytes that may be requested from a device at one time. To refine the performance of this driver, block size can be configured to 1-56 registers and 8-800 bits.

Data Types Description

Data Type	Description
Boolean	Single bit
Word	Unsigned 16-bit value bit 0 is the low bit bit 15 is the high bit
Short	Signed 16-bit value bit 0 is the low bit bit 14 is the high bit bit 15 is the sign bit
DWord	Unsigned 32-bit value bit 0 is the low bit bit 31 is the high bit
Long	Signed 32-bit value bit 0 is the low bit bit 30 is the high bit bit 31 is the sign bit
Float	32-bit floating point value. The driver interprets two consecutive 16-bit registers as a floating point value by making the second register the high word and the first register the low word.
String	Zero-terminated character array

Address Descriptions

Address specifications vary depending on the model in use. Select a link from the following list to obtain specific address information for the model of interest.

[SV100](#)

[SV180](#)

[SV180 \(2.0\)](#)

SV100 Addressing

The Thermo Westronics Ethernet Driver automatically generates tags for many of the most important device parameters. Tags can be manually created to access all device parameters mapped to Modbus address locations within the device. The following tables describe how to specify a Modbus address when creating a tag. The default data types for dynamically defined tags are shown in **bold**.

Note: The full range of addresses accepted by this driver may not be valid for each particular device.

Modbus Addressing Decimal Format

Address	Range	Data Type	Access
Output Coils	000001-065536	Boolean	Read/Write
Input Coils	100001-165536	Boolean	Read Only
Internal Registers	300001-305000	Word, Short	Read Only
	300001.0-300001.15...305000.0-305000.15	Boolean	
	305001-306000	DWord, Long	
	306001-307000	Word, Short	
	306001.0-306001.15...307000.0-307000.15	Boolean	
	307001-308000	Float	
	308001-365536	Word, Short	
Holding Registers	308001.0-308001.15...365536.0-365536.15	Boolean	Read/Write
	400001-406000	Word, Short	
	400001.0-400001.15...406000.0-406000.15	Boolean	
	406001-407000	DWord, Long	
	407001-408000	Word, Short	
	407001.0-407001.15...408000.0-408000.15	Boolean	
	408001-409000	Float	
409001-465536	Word, Short		

Address	Range	Data Type	Access
	409001.0-409001.15...465536.0-465536.15	Boolean	

Modbus Addressing Hexadecimal Format

Address	Range	Data Type	Access
Output Coils	H000001-H010000	Boolean	Read/Write
Input Coils	H100001-H110000	Boolean	Read Only
Internal Registers	H300001-H301388	Word, Short	Read Only
	H300001.0-H300001.F...H301388.0-H301388.F	Boolean	
	H301389-H301770	DWord, Long	
	H301771-H301B58	Word, Short	
	H301771.0-H301771.F...H301B58.0-H301B58.F	Boolean	
	H301B59-H301F40	Float	
	H301F41-H310000	Word, Short	
Holding Registers	H400001-H401770	Word, Short	Read/Write
	H400001.0-H400001.F...H401770.0-H401770.F	Boolean	
	H401771-H401B58	DWord, Long	
	H401B59-H401F40	Word, Short	
	H401B59.0-H401B59.F...H401F40.0-H401F40.F	Boolean	
	H401F41-H402328	Float	
	H402329-H410000	Word, Short	
H402329.0-H402329.F...H410000.0-H410000.F	Boolean		

Array Support

Arrays are supported for 16-bit internal and holding register locations for all data types except Boolean and strings. There are two methods of addressing an array. The examples below use holding register locations.

4xxxx [rows] [cols]

4xxxx [cols] (this method assumes rows is equal to one)

Rows multiplied by cols cannot exceed the block size that has been assigned to the device for the register type. For arrays of 32-bit data types, rows multiplied by cols multiplied by 2 cannot exceed the block size.

SV180 Addressing

The SV180 model is for SV180 devices using firmware versions prior to 2.0A. If the device uses firmware 2.0A or later, select the SV180 (2.0) model. For more information, refer to [SV180 \(2.0\) Addressing](#).

The Thermo Westronics Ethernet Driver automatically generates tags for many of the most important device parameters. Tags can be manually created to access all device parameters mapped to Modbus address locations within the device. The following tables describe how to specify a Modbus address when creating a tag. The default data types for dynamically defined tags are shown in **bold**.

● **Note:** The full range of addresses accepted by this driver may not be valid for each particular device.

Modbus Addressing Decimal Format

Address	Range	Data Type	Access
Output Coils	000001-065536	Boolean	Read/Write
Input Coils	100001-165536	Boolean	Read Only
Internal Registers	300001-305000	Word, Short	Read Only
	300001.0-300001.15...305000.0-305000.15	Boolean	
	305001-306000	DWord, Long	
	306001-307000	Word, Short	
	306001.0-306001.15...307000.0-307000.15	Boolean	
	307001-308000	Float	
	308001-365536	Word, Short	
Holding Registers	308001.0-308001.15...365536.0-365536.15	Boolean	Read/Write
	400001-405000	Word, Short	
	400001.0-400001.15...405000.0-405000.15	Boolean	
	405001-406000	DWord, Long	
	406001-407000	Word, Short	
	406001.0-406001.15...407000.0-407000.15	Boolean	
	407001-408000	Float	
408001-465536	Word, Short		
408001.0-408001.15...465536.0-465536.15	Boolean		

Modbus Addressing Hexadecimal Format

Address	Range	Data Type	Access
Output Coils	H000001-H010000	Boolean	Read/Write
Input Coils	H100001-H110000	Boolean	Read Only
Internal Registers	H300001-H301388	Word, Short	Read Only
	H300001.0-H300001.F ...H301388.0-H301388.F	Boolean	
	H301389-H301770	DWord, Long	
	H301771-H301B58	Word, Short	
	H301771.0-H301771.F ...H301B58.0-H301B58.F	Boolean	
	H301B59-H301F40	Float	
	H301F41-H310000	Word, Short	
	H301F41.0-H301F41.F ...H310000.0-H310000.F	Boolean	
Holding Registers	H400001-H401388	Word, Short	Read/Write
	H400001.0-H400001.F...H401388.0-H401388.F	Boolean	
	H401389-H401770	DWord, Long	
	H401771-H401B58	Word, Short	
	H401771.0-H401771.F... H401B58.0-H401B58.F	Boolean	
	H401B59-H401F40	Float	
	H401F41-H410000	Word, Short	
	H401F41.0-H401F41.F...H410000.0-H410000.F	Boolean	

Array Support

Arrays are supported for 16-bit internal and holding register locations for all data types except Boolean and strings. There are two methods of addressing an array. The examples below use holding register locations.

4xxx [rows] [cols]

4xxx [cols] (this method assumes rows is equal to one)

Rows multiplied by cols cannot exceed the block size that has been assigned to the device for the register type. For arrays of 32-bit data types, rows multiplied by cols multiplied by 2 cannot exceed the block size.

SV180 (2.0) Addressing

The SV180 (2.0) model is for SV180 devices using firmware version 2.0A or later. If the device uses an earlier firmware version, select the SV180 model. For more information, refer to [SV180 Addressing](#).

The Thermo Westronics Ethernet Driver automatically generates tags for many of the most important device parameters. Tags can be manually created to access all device parameters mapped to Modbus address locations within the device. The following tables describe how to specify a Modbus address when creating a tag. The default data types for dynamically defined tags are shown in **bold**.

● **Note:** The full range of addresses accepted by this driver may not be valid for each particular device.

Modbus Addressing Decimal Format

Address	Range	Data Type	Access
Output Coils	000001-065536	Boolean	Read/Write
Input Coils	100001-165536	Boolean	Read Only
Internal Registers	NA	NA	NA
Holding Registers	400001-465535*	Float	Read/Write

Modbus Addressing Hexadecimal Format

Address	Range	Data Type	Access
Output Coils	H000001-H010000	Boolean	Read/Write
Input Coils	H100001-H110000	Boolean	Read Only
Internal Registers	NA	NA	NA
Holding Registers	H400001-H410000*	Float	Read/Write

* Each value uses two registers when the device is configured to use the 2x16 floating point format. For example, Point 1 Data uses 400001 and 400002, Point 2 Data 2 uses 400003 and 400004 and so forth. Tags should address the first register used for the value. Each value uses one register when the device is configured to use the 1x32 floating point format. For example, Point 1 Data 1 uses 400001, Point 2 Data uses 400002 and so forth. For more information, refer to [Settings](#).

Array Support

Arrays are supported for 16-bit internal and holding register locations for all data types except Boolean and strings. There are two methods of addressing an array. The examples below use holding register locations.

4xxxx [rows] [cols]

4xxxx [cols] (this method assumes rows is equal to one)

Rows multiplied by cols cannot exceed the block size that has been assigned to the device for the register type. For arrays of 32-bit data types, rows multiplied by cols multiplied by 2 cannot exceed the block size.

Error Descriptions

The following error/warning messages may be generated. Click on the link for a description of the message.

Address Validation

[Missing address](#)

[Device address <address> contains a syntax error](#)

[Address <address> is out of range for the specified device or register](#)

[Device address <address> is not supported by model <model name>](#)

[Data Type <type> is not valid for device address <address>](#)

[Device address <address> is Read Only](#)

[Array size is out of range for address <address>](#)

[Array support is not available for the specified address: <address>](#)

Device Status Messages

[Device <device name> is not responding](#)

[Unable to write to <address> on device <device name>](#)

Device-Specific Messages

[Failure to initiate 'Winsock.dll'](#)

[Bad address in block \[<start address> to <end address>\] on device <device name>](#)

Missing address

Error Type:

Warning

Possible Cause:

A tag address that has been specified dynamically has no length.

Solution:

Re-enter the address in the client application.

Device address <address> contains a syntax error

Error Type:

Warning

Possible Cause:

A tag address that has been specified dynamically contains one or more invalid characters.

Solution:

Re-enter the address in the client application.

Address <address> is out of range for the specified device or register

Error Type:

Warning

Possible Cause:

A tag address that has been specified dynamically references a location that is beyond the range of supported locations for the device.

Solution:

Verify that the address is correct; if it is not, re-enter it in the client application.

Device address <address> is not supported by model <model name>

Error Type:

Warning

Possible Cause:

A tag address that has been specified dynamically references a location that is valid for the communications protocol but not supported by the target device.

Solution:

Verify that the address is correct; if it is not, re-enter it in the client application. Also verify that the selected model name for the device is correct.

Data Type <type> is not valid for device address <address>

Error Type:

Warning

Possible Cause:

A tag address that has been specified dynamically has been assigned an invalid data type.

Solution:

Modify the requested data type in the client application.

Device address <address> is Read Only

Error Type:

Warning

Possible Cause:

A tag address that has been specified dynamically has a requested access mode that is not compatible with what the device supports for that address.

Solution:

Change the access mode in the client application.

Array size is out of range for address <address>

Error Type:

Warning

Possible Cause:

A tag address that has been specified dynamically is requesting an array size that is too large for the address type or block size of the driver.

Solution:

Re-enter the address in the client application to specify a smaller value for the array or a different starting point.

Array support is not available for the specified address: <address>

Error Type:

Warning

Possible Cause:

A tag address that has been specified dynamically contains an array reference for an address type that doesn't support arrays.

Solution:

Re-enter the address in the client application to remove the array reference or correct the address type.

Device <device name> is not responding

Error Type:

Serious

Possible Cause:

1. The connection between the device and the Host PC is broken.
2. The communication parameters for the connection are incorrect.
3. The named device may have been assigned an incorrect Network ID.
4. The response from the device took longer to receive than the amount of time specified in the "Request Timeout" device setting.

Solution:

1. Verify the cabling between the PC and the device.
2. Verify that the specified communication parameters match those of the device.
3. Verify that the Network ID given to the named device matches that of the actual device.
4. Increase the Request Timeout setting so that the entire response can be handled.

Unable to write to <address> on device <device name>

Error Type:

Serious

Possible Cause:

1. The named device may not be connected to the network.
2. The named device may have been assigned an incorrect Network ID.

3. The named device is not responding to write requests.
4. The address does not exist in the PLC.

Solution:

1. Check the PLC network connections.
2. Verify that the Network ID given to the named device matches that of the actual device.

Failure to initiate 'Winsock.dll'

Error Type:

Fatal

Possible Cause:

Could not negotiate with the operating systems Winsock 1.1 functionality.

Solution:

Verify that the Winsock.dll is properly installed on the system.

Bad address in block [<start address> to <end address>] on device <device name>

Error Type:

Serious

Possible Cause:

An attempt has been made to reference a nonexistent location in the specified device.

Solution:

Verify the tags assigned to addresses in the specified range on the device and eliminate ones that reference invalid locations.

Index

A

Address <address> is out of range for the specified device or register 25

Address Descriptions 20

Allow Sub Groups 14

Array size is out of range for address <address> 26

Array support is not available for the specified address: <address> 27

Attempts Before Timeout 12

Auto-Demotion 12

B

Bad address in block [<start address> to <end address>] on device <device name> 28

Block Sizes 16

Boolean 19

C

Channel Assignment 9

Channel Properties — Advanced 8

Channel Properties — Ethernet Communications 7

Channel Properties — General 5

Channel Properties — Write Optimizations 7

Communications Timeouts 11

Connect Timeout 11

Create 15

D

Data Collection 10

Data Type <type> is not valid for device address <address> 26

Data Types Description 19

Delete 14

Demote on Failure 12

Demotion Period 13

Device <device name> is not responding 27

Device address <address> contains a syntax error 25
Device address <address> is not supported by model <model name> 26
Device address <address> is Read Only 26
Device ID 4
Device Properties — Auto-Demotion 12
Device Properties — General 9
Device Properties — Redundancy 17
Device Properties — Tag Generation 13
Device Properties — Timing 11
Diagnostics 5
Discard Requests when Demoted 13
Do Not Scan, Demand Poll Only 11
Driver 9
Duty Cycle 8
DWord 19

E

Error Descriptions 25
Ethernet Settings 7

F

Failure to initiate 'winsock.dll' 28
Float 19

G

General 9
Generate 14

I

ID 9
Identification 5, 9
Initial Updates from Cache 11
Inter-Device Delay 8

L

Long 19

M

Missing address 25

Model 9

N

Name 9

Network Adapter 7

Non-Normalized Float Handling 8

O

On Device Startup 13

On Duplicate Tag 14

On Property Change 13

Operating Mode 10

Optimization Method 7

Optimizing Communications 18

Overview 4

Overwrite 14

P

Parent Group 14

R

Redundancy 17

Replace with Zero 8

Request Timeout 12

Respect Tag-Specified Scan Rate 11

S

Scan Mode 11
Settings 17
Setup 4
Short 19
Simulated 10
String 19
SV100 Addressing 20
SV180 (2.0) Addressing 24
SV180 Addressing 22

T

Tag Counts 6, 10
Tag Generation 13
TCP/IP 16
Timeouts to Demote 12
Timing 11

U

Unable to write tag <address> on device <device name> 27
Unmodified 8

W

Word 19
Write All Values for All Tags 7
Write Only Latest Value for All Tags 8
Write Only Latest Value for Non-Boolean Tags 7