

Yokogawa Darwin Serial Driver Help

© 2012 Kepware Technologies

Table of Contents

Table of Contents	2
Yokogawa Darwin Serial Driver Help	3
Overview	3
Device Setup	4
Modem Setup	8
Communications Parameters	10
Data Types Description	12
Address Descriptions	13
DA100-1 Addressing	13
DA100-2 Addressing	14
DR130 Addressing	16
DR231 Addressing	18
DR232 Addressing	19
DR241 Addressing	21
DR242 Addressing	23
DC100-1 Addressing	24
DC100-2 Addressing	26
Automatic Tag Database Generation	29
Error Descriptions	32
Address Validation	32
Address '<address>' is out of range for the specified device or register	32
Data Type '<type>' is not valid for device address '<address>'	32
Device address '<address>' contains a syntax error	32
Device address '<address>' is Read Only	33
Missing address	33
The device '<device name>' responded with a NAK to a read request starting at address '<address>'	33
The requested address may not exist in the device	33
Serial Communications	33
Communications error on '<channel name>' [<error mask>]	33
COMn does not exist	34
COMn is in use by another application	34
Error opening COMn	34
Unable to set comm parameters on COMn	34
Device Status Messages	34
Device '<device name>' is not responding	35
Unable to write to '<address>' on device '<device name>'	35
Index	36

Yokogawa Darwin Serial Driver Help

Help version 1.017

CONTENTS

[Overview](#)

What is the Yokogawa Darwin Serial Driver?

[Device Setup](#)

How do I configure a device for use with this driver?

[Data Types Description](#)

What data types does this driver support?

[Address Descriptions](#)

How do I address a data location on a Yokogawa Darwin Serial device?

[Automatic Tag Database Generation](#)

How can I easily configure tags for the Yokogawa Darwin Serial Driver?

[Error Descriptions](#)

What error messages does the Yokogawa Darwin Serial Driver produce?

Overview

The Yokogawa Darwin Serial Driver provides an easy and reliable way to connect Yokogawa Darwin Serial devices to OPC Client applications, including HMI, SCADA, Historian, MES, ERP and countless custom applications. It is intended for use with Yokogawa Data Acquisition and Data Recorder devices that support RS-232 and RS-422 communications.

Device Setup

Supported Yokogawa Devices

DA100-1
DA100-2
DR131
DR231
DR232
DR241
DR242
DC100-1
DC100-2

Supported Communication Parameters

Baud Rate: 300, 600, 1200, 2400, 9600, 19200, or 38400.
Parity: None, Even, or Odd.
Data Bits: 8
Stop Bits: 1 or 2.
Flow Control: None, RTS, or DTR.

Note 1: Software handshaking is not available.

Note 2: This driver makes use of binary data formatting when reading information from Yokogawa devices. This requires that data bit setting 8 be used.

RS-232 and RS-422/485 Operation

Yokogawa Darwin devices can support RS-232 or RS-422/485 operation. The mode that is used depends on the configuration of the OPC server project.

If intending to connect to a Darwin device using RS-232, select a Device ID of zero (0). This tells the driver to use the RS-232 mode for communications. If intending to use either RS-422 or RS-485 communications, select a Device ID for each station that is between 1 and 16 for RS-422, and between 1 and 31 for RS-485. When using RS-232, only configure one device on the channel.

Request Timeout

This parameter specifies the amount of time that the driver will wait for a response from the device before giving up and going on to the next request. Long timeouts will only affect performance if a device is not responding. The valid range is 100 to 30000 milliseconds. The default setting is 5000 milliseconds.

Retry Attempts

This parameter specifies the number of times that the driver will retry a message before giving up and going on to the next message. The valid range is 1 to 10. The default setting is 3.


Note: For more information, refer to the OPC server's help documentation.

Device ID

When operating in RS-232 mode, the Device ID has no meaning for this driver. When the driver is operating in the RS-422 mode, the Device ID has a valid range of 1 to 31. The default setting is 1.

Cable Diagrams

RS-232 Connector and Signal Names

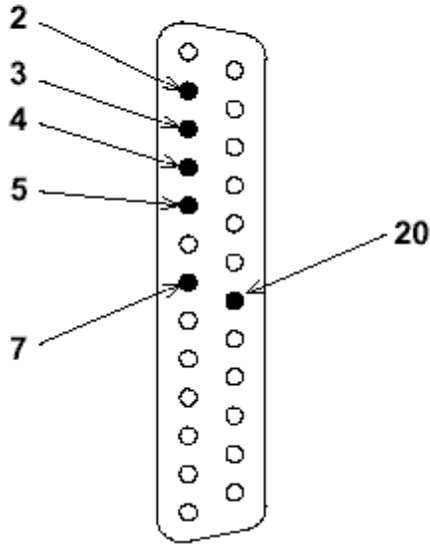


- 2. **TXD (Send Data)**: Data transmitted to the host computer.
- 3. **RXD (Received Data)**: Data received from the host computer.
- 4. **RTS (Request to Send)**: Handshake signal used for reception of data from the host computer.
- 5. **CTS (Clear to Send)**: Handshake signal used for transmission of data to the host computer.
- 7. **GND (Signal Ground)**: Signal ground connection.
- 20. **DTR (Equipment Ready)**: Handshake signal used for reception of data from the host computer.

Note: Pin numbers 1, 6 and 8 to 19 are not used.

RS-232 Communications Module Settings

The default settings are shown in bold.

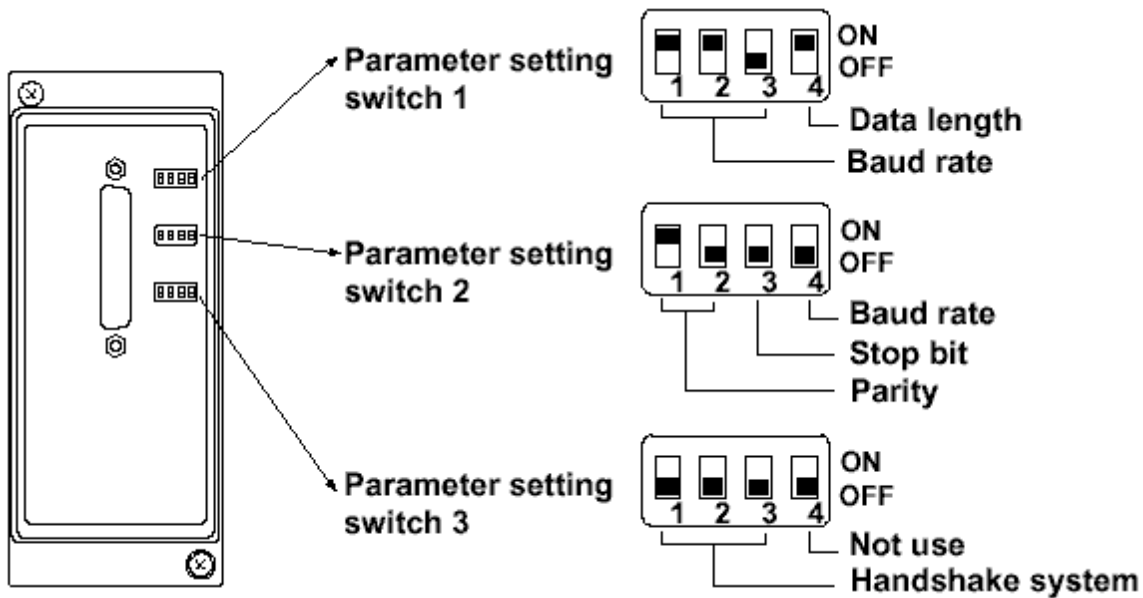

Baud Rate (No.1 to 3 of Setting Switch 1 and No.4 of Setting Switch 2)
Baud Rate No.1 No.2 No.3 No.4 (Switch 2)

00	OFF	OFF	ON	OFF
600	OFF	ON	OFF	OFF
1200	OFF	ON	ON	OFF
2400	ON	OFF	OFF	OFF
4800	ON	OFF	ON	OFF
9600	ON	ON	OFF	OFF
19200	ON	ON	ON	OFF
8400	OFF	OFF	OFF	ON

Data Length (Switch No.4 of Parameter Setting Switch 1)

Data Length No.4

- 7. OFF
- 8. ON -Default

**Parity (Switch No.1 and 2 of Parameter Setting Switch 2)
Parity No.1 No.2**

NONE	OFF	OFF
ODD	OFF	ON
EVEN	ON	OFF

**Stop Bit (Switch No.3 of Parameter Setting Switch 2)
Stop Bit No.4**


- 1. OFF - Default
- 2. ON

**Handshake System (Switch No.1 to 3 of Parameter Setting Switch 3)
Handshake System No.1 No.2 No.3**

No Handshake	OFF	OFF	OFF
XON-ER*	OFF	OFF	ON
XON-RS*	OFF	ON	OFF
CS-ER	OFF	ON	ON
CS-RS	ON	OFF	OFF


*When the baud rate is set to 38400, there is no handshaking.

Note: Handshaking must be set to **No Handshake** at all times.

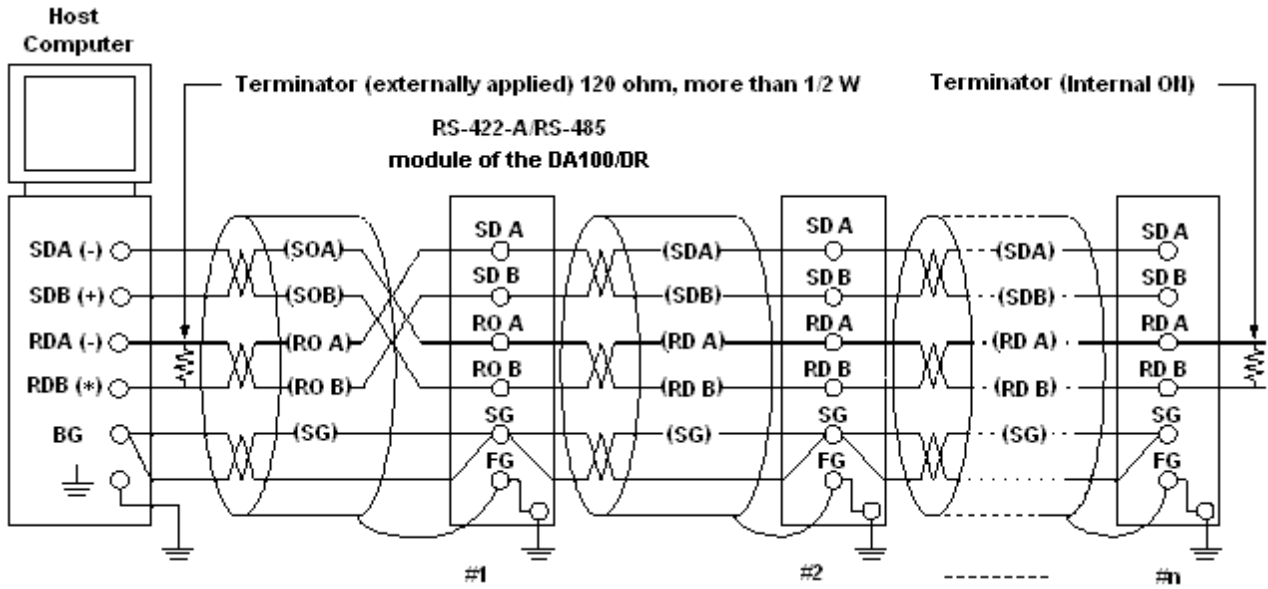

Note: No terminators are inserted between # 1 through #n-1 (terminator OFF).

RS-422 Cable Diagram

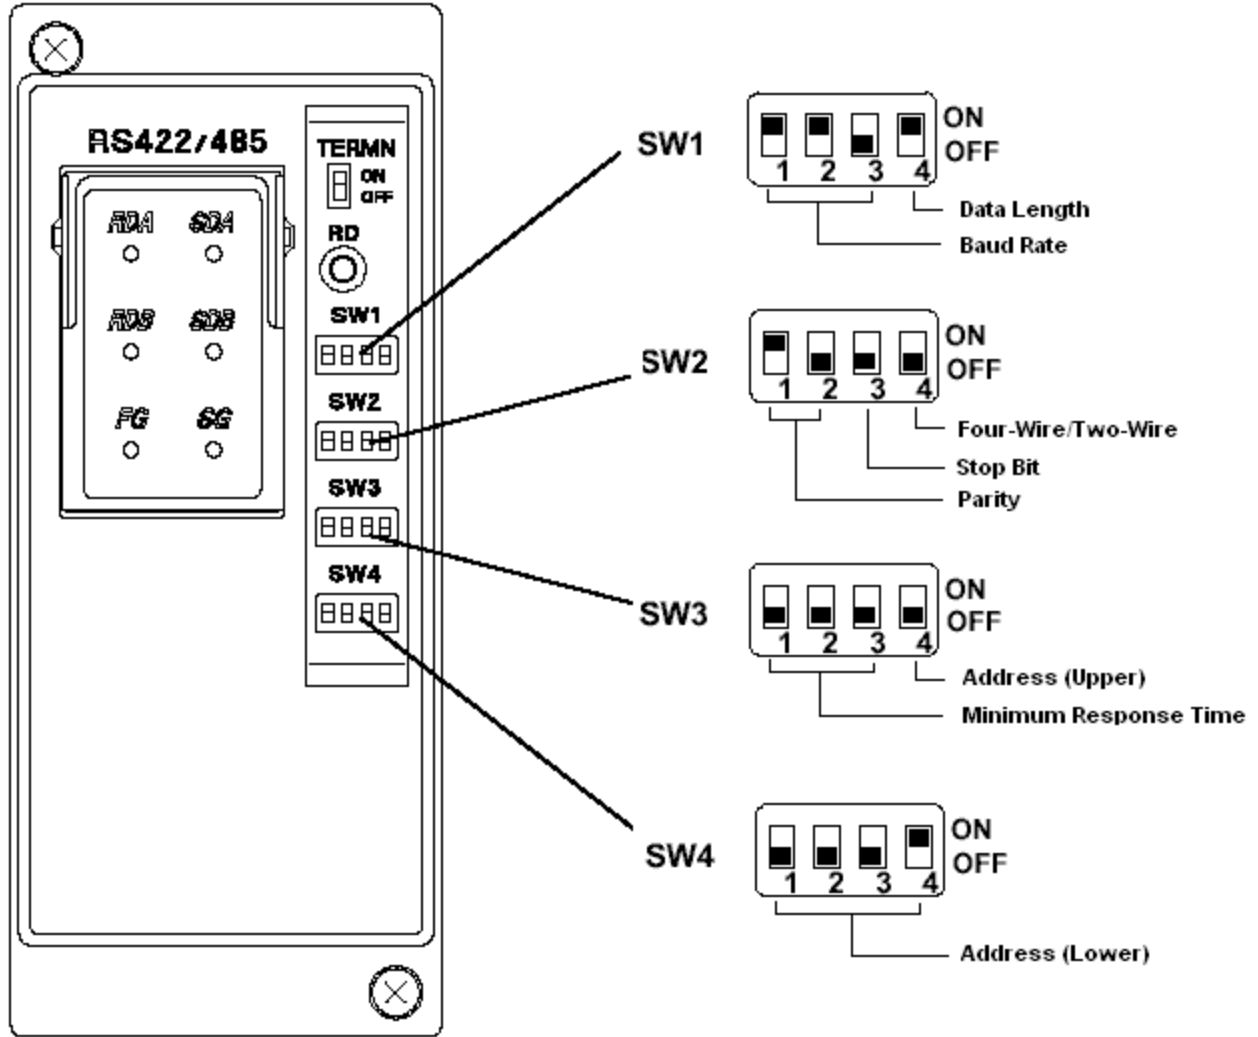

RS-232 Communications Module Settings

Baud Rate (No.1 to 3 of SW1)
Baud Rate No.1 No.2 No.3

00	OFF	OFF	ON
600	OFF	ON	OFF
1200	OFF	ON	ON
2400	ON	OFF	OFF
4800	ON	OFF	ON
9600	ON	ON	OFF
19200	ON	ON	ON
38400	OFF	OFF	OFF

Data Length (No.4 of SW1)
Data Length No.4

- 7. OFF
- 8. ON- Default Setting

Parity (No.1 to 2 of SW2)
Parity No.1 No.2

NONE	OFF	OFF
ODD	OFF	ON
EVEN	ON	OFF

Stop Bit (No.3 of SW2)**Stop Bit No.3**

1. OFF - Default Setting
2. ON

Switch Between Four-Wire/Two-Wire Systems (No.4 of SW2)**Four-Wire/Two-Wire No.4**

Four-Wire	OFF
Two-Wire	ON

Minimum Response Time (No.1 to 3 of SW3)**Minimum Response Time No.1 No.2 No.3**

0ms	OFF	OFF	OFF
10ms	OFF	OFF	ON
20ms	OFF	ON	OFF
50ms	OFF	ON	ON
100ms	ON	OFF	OFF


Address (No.4 of SW3 and No.1 to 4 of SW4)**Address No.4 (SW3) No.1 (SW4) No.2 (SW4) No.3 (SW4) No.4 (SW4)**

1	OFF	OFF	OFF	OFF	ON
2	OFF	OFF	OFF	ON	OFF
3	OFF	OFF	OFF	ON	ON
4	OFF	OFF	ON	OFF	OFF
5	OFF	OFF	ON	OFF	ON
6	OFF	OFF	ON	ON	OFF
7	OFF	OFF	ON	ON	ON
8	OFF	ON	OFF	OFF	OFF
9	OFF	ON	OFF	OFF	ON
10	OFF	ON	OFF	ON	OFF
11	OFF	ON	OFF	ON	ON
12	OFF	ON	ON	OFF	OFF
13	OFF	ON	ON	OFF	ON
14	OFF	ON	ON	ON	OFF
15	OFF	ON	ON	ON	ON
16	ON	OFF	OFF	OFF	OFF
17	ON	OFF	OFF	OFF	ON
18	ON	OFF	OFF	ON	OFF
19	ON	OFF	OFF	ON	ON
20	ON	OFF	ON	OFF	OFF
21	ON	OFF	ON	OFF	ON
22	ON	OFF	ON	ON	OFF
23	ON	OFF	ON	ON	ON
24	ON	ON	OFF	OFF	OFF
25	ON	ON	OFF	OFF	ON
26	ON	ON	OFF	ON	OFF
27	ON	ON	OFF	ON	ON
28	ON	ON	ON	OFF	OFF
29	ON	ON	ON	OFF	ON
30	ON	ON	ON	ON	OFF
31	ON	ON	ON	ON	ON

Modem Setup

This driver supports modem functionality. For more information, please refer to the topic "Modem Support" in the OPC server's help documentation.

Communications Parameters

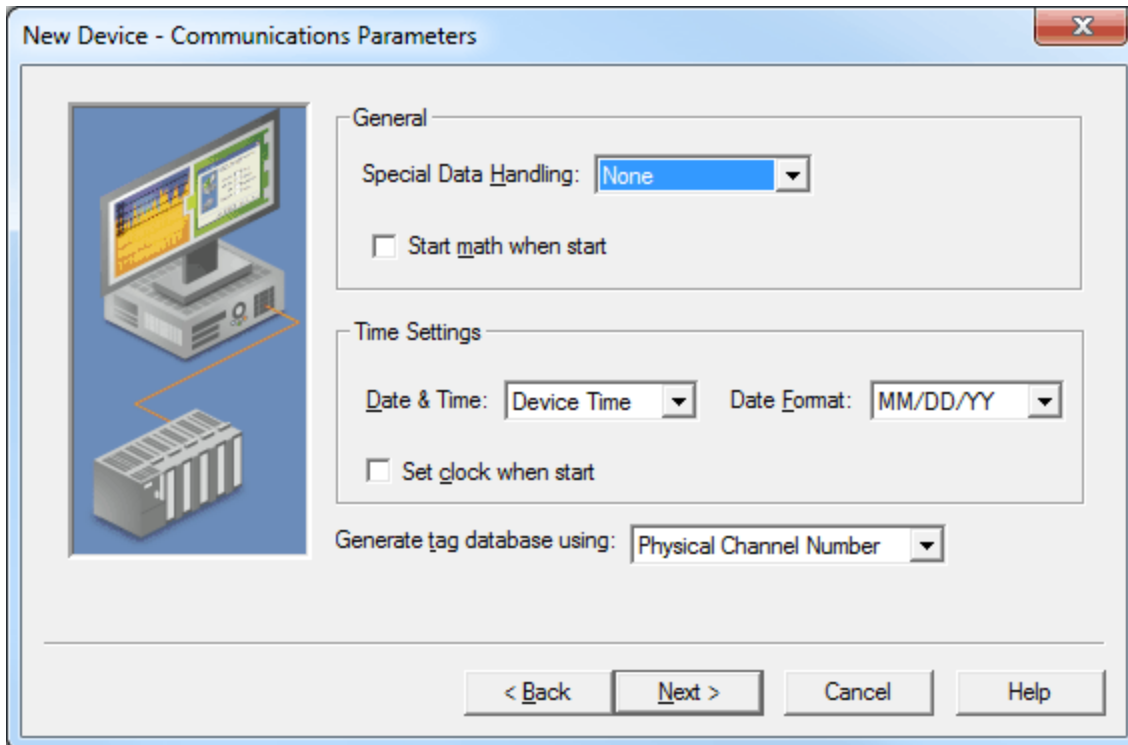

Descriptions of the parameters are as follows:

- **Special Data Handling** This parameter allows the driver to be configured to return specific data values for the numerical out of range and error conditions returned from the device. Options include None, +INF, and -INF. The default setting is None. For more information, refer to [Special Data Handling](#).
- **Start math when start:** When checked, this option will inform the driver to send a command to the device at communication startup that will start the math computation. The default setting is unchecked.
- **Date & Time:** This parameter specifies the origin of the data value of the Date and Time data types (which represent the date and time of the latest data). Options include Device Time and System Time. The default setting is Device Time. Descriptions of the options are as follows:
 - **Device Time:** When selected, the Date and Time tags will return the date and time read from the device. This date and time represents the date and time that the latest data was measured or computed based on the internal device clock.
 - **System Time:** When selected, the Date and Time tags will return the date and time that the requested data was returned from the device based on the PC system clock.
- **Date Format:** This parameter specifies the format of the return string for the Date data type. Date formats can be specified as MM/DD/YY (month/day/year), YY/MM/DD (year/month/day), or DD/MM/YY (day/month/year). The default setting is MM/DD/YY.
- **Set clock when start:** When checked, this option informs the driver to send a command to the device at communication startup that will set the device clock to the date and time settings of the system clock. The default setting is unchecked.
- **Generate tag database using:** This parameter specifies the origin of the tag name used when automatically generating a tag database. Options include Physical Channel Number and Device Tag Name. The default setting is Physical Channel Number. Descriptions of the options are as follows:
 - **Physical Channel Number:** When selected, the driver will generate tag names based on the channel number of an item. For example, "CH001" or "CH001_alarm1".
 - **Device Tag Name:** When selected, the driver will generate tag names using the tag name returned by the device for a channel. For example, "Flow" or "Flow_alarm1".

Special Data Handling

Special Data Handling specifies how to return specific data values for the numerical out of range and error conditions that are returned from the device. Options include None, +INF, and -INF. Descriptions of the options are as follows:

- **None:** When selected, special data values will be returned with the actual data value received from the device. For example, the data value of a measuring channel Over Range would be returned as 32,767 and the data value of a math channel Over Range would be returned as 2,147,450,879.
- **+INF:** When selected, special data values will be returned as a numerical representation of positive infinity (#INF). The exception is an Under Range condition that is always returned as negative infinity.
- **-INF:** When selected, special data values will be returned as a numerical representation of negative infinity (-#INF). The exception is an Over Range condition that is always returned as positive infinity.

Data Types Description

Data Type	Description
Boolean	Single bit
Byte	Unsigned 8 bit value
Word	Unsigned 16 bit value
Short	Signed 16 bit value
Float	32 bit floating point value
Double	64 bit floating point value
String	Null terminated ASCII string

Address Descriptions

Address specifications vary depending on the model in use. Select a link from the following list to obtain specific address information for the model of interest.

[DA100-1 Addressing](#)

[DA100-2 Addressing](#)

[DR130 Addressing](#)

[DR231 Addressing](#)

[DR232 Addressing](#)

[DR241 Addressing](#)

[DR242 Addressing](#)

[DC100-1 Addressing](#)

[DC100-2 Addressing](#)

DA100-1 Addressing

The driver supports the following addresses for this device. The default data type for each address type is shown in **bold**.

Measured Channels

Address Type	Format	Range	Data Types	Access
Process Value of Channel	CHxxx or CHxxx.PV	001-060	Double , Float	Read Only
Alarm Summary of Channel	CHxxx.Alarm	001-060	Short , Word, Byte	Read Only
Alarm Level1 Status of Channel	CHxxx.Alarm1	001-060	Short , Word, Byte	Read Only
Alarm Level2 Status of Channel	CHxxx.Alarm2	001-060	Short , Word, Byte	Read Only
Alarm Level3 Status of Channel	CHxxx.Alarm3	001-060	Short , Word, Byte	Read Only
Alarm Level4 Status of Channel	CHxxx.Alarm4	001-060	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHxxx.ASP1	001-060	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHxxx.ASP2	001-060	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHxxx.ASP3	001-060	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHxxx.ASP4	001-060	Double , Float	Read/Write
Upper Scale Value of Channel*	CHxxx.scale_Hi	001-060	Double , Float	Read Only
Lower Scale Value of Channel*	CHxxx.scale_Lo	001-060	Double , Float	Read Only
Unit String of Channel*	CHxxx.unit	001-060	String	Read Only
Tagname of Channel*	CHxxx.tag	001-060	String	Read Only
Status of Channel*	CHxxx.status	001-060	String	Read Only
Lowest Measuring Channel*	CH.Low		Short , Word, Byte	Read Only
Highest Measuring Channel*	CH.High		Short , Word, Byte	Read Only

Math Channels

Address Type	Format	Range	Data Types	Access
Process Value of Math Channel	CHAxX or CHAxX.PV	01-30	Double , Float	Read Only
Alarm Summary of Math Channel	CHAxX.Alarm	01-30	Short , Word, Byte	Read Only
Alarm Level1 Status of Math Channel	CHAxX.Alarm1	01-30	Short , Word, Byte	Read Only
Alarm Level2 Status of Math Channel	CHAxX.Alarm2	01-30	Short , Word, Byte	Read Only
Alarm Level3 Status of Math Channel	CHAxX.Alarm3	01-30	Short , Word, Byte	Read Only
Alarm Level4 Status of Math Channel	CHAxX.Alarm4	01-30	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHAxX.ASP1	01-30	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHAxX.ASP2	01-30	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHAxX.ASP3	01-30	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHAxX.ASP4	01-30	Double , Float	Read/Write
Upper Scale Value of Math Channel*	CHAxX.scale_Hi	01-30	Double , Float	Read Only
Lower Scale Value of Math Channel*	CHAxX.scale_Lo	01-30	Double , Float	Read Only
Unit String of Math Channel*	CHAxX.unit	01-30	String	Read Only
Tagname of Math Channel*	CHAxX.tag	01-30	String	Read Only
Status of Math Channel*	CHAxX.status	01-30	String	Read Only
Lowest Math Channel*	CHA.Low		Short , Word, Byte	Read Only
Highest Math Channel*	CHA.High		Short , Word, Byte	Read Only

*The data associated with these addresses is only read from the device at the start of a communications session. Once read, the values will not be refreshed until the server has been restarted or the "Reset" tag has been invoked. To invoke a reset, write a non zero value to the Reset tag. Once the Reset tag has been invoked, the driver will reinitialize all startup data from the device.

Alarm Setpoints

Data values for alarm setpoints that are undefined in the device will be returned as +INF. Data values can only be written to alarm setpoints that are defined in the device. Write operations to undefined alarm setpoints will return an error. Alarm setpoint values are read one channel at a time. For devices with a large number of channels, increasing the scan rate of ASP items and/or reducing the number of active ASP items will increase the read performance of the PV and alarm data.

Scales

Data values for Scale_Hi and Scale_Lo for channels that are skipped will be returned as +INF.

Tag Names

For devices that do not support tag names (and channels that have unspecified tag names) the driver will construct an internal tag name based on the channel number. For example, the tag name of address 'CH001' will be returned as 'CH001'.

General Device Data

Address Type	Format	Range	Data Types	Access
Date of Last Data	Date		String	Read Only
Time of Last Data	Time		String	Read Only
Model Name of Device*	Model		String	Read Only
Digital Output (Main Unit)	DOxxx	001-060	Boolean	Read/Write
Digital Output (Internal Switch)	DOSxx	01-60	Boolean	Read/Write
Math Communication Data**	CDxx	01-30	Short, Word, Byte	Write Only
Control Math Execution	MathControl		Short, Word, Byte	Write Only
Reset Alarms	AlarmReset		Boolean	Write Only
Control Command and Response	Command		String	Read/Write
Direct Reloading of Configuration	Reset		Boolean	Write Only

*The model address type that returns the model name of the device may return 'DR231' for models of type DR241 and 'DR232' for models of type DR242.

**The CD address type is only valid for devices equipped with the math option. Write operations to CD addresses for non-math equipped devices will return an error. The range of valid data for addresses 'CDxx' is -32000 to 32000. CD data values are converted in the device from a whole number to a real number based on the decimal point placement specified for the associated math channel. For example, the device would interpret a data value of 32000 written to a CD address location with a decimal point placement of .000 as 32.000.

Control Math Execution

The MathControl address type is only available for devices equipped with the math option. Write operations to the MathControl tag for non-math equipped devices will return an error.

Control Command and Response

The Command address allows the user to send a string command and receive a string response to and from the device. This means that any command can be sent to the device, including commands not directly supported by the driver. Write operations using the Command address should be performed with extreme caution.

Note 1: The actual number of addresses available for of each type depends on the Yokogawa device's configuration. If the driver finds at Runtime that an address is not present in the device, it will post an error message and remove the tag from its scan list.

Note 2: Addresses that have Write Only access are assigned a default access of Read/Write. Data values are unreadable for these addresses, however, and the associated tags are not included in the scan list. The current data value for these tags will always be 0 for numeric data types and null string for string data types.

DA100-2 Addressing

The driver supports the following addresses for this device. The default data type for each address type is shown in **bold**.

Measured Channels

Address Type	Format	Range	Data Types	Access
Process Value of Channel	CHxxx or CHxxx.PV	001-560	Double , Float	Read Only
Alarm Summary of Channel	CHxxx.Alarm	001-560	Short , Word, Byte	Read Only
Alarm Level1 Status of Channel	CHxxx.Alarm1	001-560	Short , Word, Byte	Read Only
Alarm Level2 Status of Channel	CHxxx.Alarm2	001-560	Short , Word, Byte	Read Only
Alarm Level3 Status of Channel	CHxxx.Alarm3	001-560	Short , Word, Byte	Read Only
Alarm Level4 Status of Channel	CHxxx.Alarm4	001-560	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHxxx.ASP1	001-560	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHxxx.ASP2	001-560	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHxxx.ASP3	001-560	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHxxx.ASP4	001-560	Double , Float	Read/Write
Upper Scale Value of Channel*	CHxxx.scale_Hi	001-560	Double , Float	Read Only
Lower Scale Value of Channel*	CHxxx.scale_Lo	001-560	Double , Float	Read Only
Unit String of Channel*	CHxxx.unit	001-560	String	Read Only
Tagname of Channel*	CHxxx.tag	001-560	String	Read Only
Status of Channel*	CHxxx.status	001-560	String	Read Only
Lowest Measuring Channel*	CH.Low		Short , Word, Byte	Read Only
Highest Measuring Channel*	CH.High		Short , Word, Byte	Read Only

Math Channels

Address Type	Format	Range	Data Types	Access
Process Value of Math Channel	CHAxX or CHAxX.PV	01-60	Double , Float	Read Only
Alarm Summary of Math Channel	CHAxX.Alarm	01-60	Short , Word, Byte	Read Only
Alarm Level1 Status of Math Channel	CHAxX.Alarm1	01-60	Short , Word, Byte	Read Only
Alarm Level2 Status of Math Channel	CHAxX.Alarm2	01-60	Short , Word, Byte	Read Only
Alarm Level3 Status of Math Channel	CHAxX.Alarm3	01-60	Short , Word, Byte	Read Only
Alarm Level4 Status of Math Channel	CHAxX.Alarm4	01-60	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHAxX.ASP1	01-60	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHAxX.ASP2	01-60	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHAxX.ASP3	01-60	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHAxX.ASP4	01-60	Double , Float	Read/Write
Upper Scale Value of Math Channel*	CHAxX.scale_Hi	01-60	Double , Float	Read Only
Lower Scale Value of Math Channel*	CHAxX.scale_Lo	01-60	Double , Float	Read Only
Unit String of Math Channel*	CHAxX.unit	01-60	String	Read Only
Tagname of Math Channel*	CHAxX.tag	01-60	String	Read Only
Status of Math Channel*	CHAxX.status	01-60	String	Read Only
Lowest Math Channel*	CHA.Low		Short , Word, Byte	Read Only
Highest Math Channel*	CHA.High		Short , Word, Byte	Read Only

*The data associated with these addresses is only read from the device at the start of a communications session. Once read, the values will not be refreshed until the server has been restarted or the "Reset" tag has been invoked. To invoke a reset, write a non-zero value to the Reset tag. Once the Reset tag has been invoked, the driver will reinitialize all startup data from the device.

Alarm Setpoints

Data values for alarm setpoints that are undefined in the device will be returned as +INF. Data values can only be written to alarm setpoints that are defined in the device. Write operations to undefined alarm setpoints will return an error. Alarm setpoint values are read one channel at a time. For devices with a large number of channels, increasing the scan rate of ASP items and/or reducing the number of active ASP items will increase the read performance of the PV and alarm data.

Scales

Data values for Scale_Hi and Scale_Lo for channels that are skipped will be returned as +INF.

Tag Names

For devices that do not support tag names (and channels that have unspecified tag names) the driver will construct an internal tag name based on the channel number. For example, the tag name of address 'CH001' will be returned as 'CH001'.

General Device Data

Address Type	Format	Range	Data Types	Access
Date of Last Data	Date		String	Read Only
Time of Last Data	Time		String	Read Only
Model Name of Device*	Model		String	Read Only
Digital Output (Main Unit)	DOIxx	01-60	Boolean	Read/Write
Digital Output (Internal Switch)	DOSxx	01-60	Boolean	Read/Write
Digital Output (Sub Units)	DOxxx	001-560	Boolean	Read/Write
Math Communication Data**	CDxx	01-60	Short, Word, Byte	Write Only
Control Math Execution	MathControl		Short, Word, Byte	Write Only
Reset Alarms	AlarmReset		Boolean	Write Only
Control Command and Response	Command		String	Read/Write
Direct Reloading of Configuration	Reset		Boolean	Write Only

*The model address type that returns the model name of the device may return 'DR231' for models of type DR241 and 'DR232' for models of type DR242.

**The CD address type is only valid for devices equipped with the math option. Write operations to CD addresses for non-math equipped devices will return an error. The range of valid data for addresses 'CDxx' is -32000 to 32000. CD data values are converted in the device from a whole number to a real number based on the decimal point placement specified for the associated math channel. For example, the device would interpret a data value of 32000 written to a CD address location with a decimal point placement of .000 as 32.000.

Control Math Execution

The MathControl address type is only available for devices equipped with the math option. Write operations to the MathControl tag for non-math equipped devices will return an error.

Control Command and Response

The Command address allows the user to send a string command and receive a string response to and from the device. This means that any command can be sent to the device, including commands not directly supported by the driver. Write operations using the Command address should be performed with extreme caution.

Note 1: The actual number of addresses available for of each type depends on the Yokogawa device's configuration. If the driver finds at Runtime that an address is not present in the device, it will post an error message and remove the tag from its scan list.

Note 2: Addresses that have Write Only access are assigned a default access of Read/Write. Data values are unreadable for these addresses, however, and the associated tags are not included in the scan list. The current data value for these tags will always be 0 for numeric data types and null string for string data types.

DR130 Addressing

The driver supports the following addresses for this device. The default data type for each address type is shown in **bold**.

Measured Channels

Address Type	Format	Range	Data Types	Access
Process Value of Channel	CHxxx or CHxxx.PV	001-020	Double , Float	Read Only
Alarm Summary of Channel	CHxxx.Alarm	001-020	Short , Word, Byte	Read Only
Alarm Level1 Status of Channel	CHxxx.Alarm1	001-020	Short , Word, Byte	Read Only
Alarm Level2 Status of Channel	CHxxx.Alarm2	001-020	Short , Word, Byte	Read Only
Alarm Level3 Status of Channel	CHxxx.Alarm3	001-020	Short , Word, Byte	Read Only
Alarm Level4 Status of Channel	CHxxx.Alarm4	001-020	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHxxx.ASP1	001-020	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHxxx.ASP2	001-020	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHxxx.ASP3	001-020	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHxxx.ASP4	001-020	Double , Float	Read/Write
Upper Scale Value of Channel*	CHxxx.scale_Hi	001-020	Double , Float	Read Only
Lower Scale Value of Channel*	CHxxx.scale_Lo	001-020	Double , Float	Read Only
Unit String of Channel*	CHxxx.unit	001-020	String	Read Only
Tagname of Channel*	CHxxx.tag	001-020	String	Read Only
Status of Channel*	CHxxx.status	001-020	String	Read Only
Lowest Measuring Channel*	CH.Low		Short , Word, Byte	Read Only

Highest Measuring Channel*	CH.High		Short, Word, Byte	Read Only
----------------------------	---------	--	-------------------	-----------

Math Channels

Address Type	Format	Range	Data Types	Access
Process Value of Math Channel	CHAxX or CHAxX.PV	01-30	Double, Float	Read Only
Alarm Summary of Math Channel	CHAxX.Alarm	01-30	Short, Word, Byte	Read Only
Alarm Level1 Status of Math Channel	CHAxX.Alarm1	01-30	Short, Word, Byte	Read Only
Alarm Level2 Status of Math Channel	CHAxX.Alarm2	01-30	Short, Word, Byte	Read Only
Alarm Level3 Status of Math Channel	CHAxX.Alarm3	01-30	Short, Word, Byte	Read Only
Alarm Level4 Status of Math Channel	CHAxX.Alarm4	01-30	Short, Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHAxX.ASP1	01-30	Double, Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHAxX.ASP2	01-30	Double, Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHAxX.ASP3	01-30	Double, Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHAxX.ASP4	01-30	Double, Float	Read/Write
Upper Scale Value of Math Channel*	CHAxX.scale_Hi	01-30	Double, Float	Read Only
Lower Scale Value of Math Channel*	CHAxX.scale_Lo	01-30	Double, Float	Read Only
Unit String of Math Channel*	CHAxX.unit	01-30	String	Read Only
Tagname of Math Channel*	CHAxX.tag	01-30	String	Read Only
Status of Math Channel*	CHAxX.status	01-30	String	Read Only
Lowest Math Channel*	CHA.Low		Short, Word, Byte	Read Only
Highest Math Channel*	CHA.High		Short, Word, Byte	Read Only

*The data associated with these addresses is only read from the device at the start of a communications session. Once read, the values will not be refreshed until the server has been restarted or the "Reset" tag has been invoked. To invoke a reset, write a non-zero value to the Reset tag. Once the Reset tag has been invoked, the driver will reinitialize all startup data from the device.

Alarm Setpoints

Data values for alarm setpoints that are undefined in the device will be returned as +INF. Data values can only be written to alarm setpoints that are defined in the device. Write operations to undefined alarm setpoints will return an error. Alarm setpoint values are read one channel at a time. For devices with a large number of channels, increasing the scan rate of ASP items and/or reducing the number of active ASP items will increase the read performance of the PV and alarm data.

Scales

Data values for Scale_Hi and Scale_Lo for channels that are skipped will be returned as +INF.

Tag Names

For devices that do not support tag names (and channels that have unspecified tag names) the driver will construct an internal tag name based on the channel number. For example, the tag name of address 'CH001' will be returned as 'CH001'.

General Device Data

Address Type	Format	Range	Data Types	Access
Date of Last Data	Date		String	Read Only
Time of Last Data	Time		String	Read Only
Model Name of Device*	Model		String	Read Only
Math Communication Data**	CDxx	01-30	Short, Word, Byte	Write Only
Control Math Execution	MathControl		Short, Word, Byte	Write Only
Reset Alarms	AlarmReset		Boolean	Write Only
Control Command and Response	Command		String	Read/Write
Direct Reloading of Configuration	Reset		Boolean	Write Only

*The model address type that returns the model name of the device may return 'DR231' for models of type DR241 and 'DR232' for models of type DR242.

**The CD address type is only valid for devices equipped with the math option. Write operations to CD addresses for non-math equipped devices will return an error. The range of valid data for addresses 'CDxx' is -32000 to 32000. CD data values are converted in the device from a whole number to a real number based on the decimal point placement specified for the associated math channel. For example, the device would interpret a data value of 32000 written to a CD address location with a decimal point placement of .000 as 32.000.

Control Math Execution

The MathControl address type is only available for devices equipped with the math option. Write operations to the MathControl tag for non-math equipped devices will return an error.

Control Command and Response

The Command address allows the user to send a string command and receive a string response to and from the device. This means that any command can be sent to the device, including commands not directly supported by the driver. Write operations using the Command address should be performed with extreme caution.

Note 1: The actual number of addresses available for of each type depends on the Yokogawa device's configuration. If the driver finds at Runtime that an address is not present in the device, it will post an error message and remove the tag from its scan list.

Note 2: Addresses that have Write Only access are assigned a default access of Read/Write. Data values are unreadable for these addresses, however, and the associated tags are not included in the scan list. The current data value for these tags will always be 0 for numeric data types and null string for string data types.

DR231 Addressing

The driver supports the following addresses for this device. The default data type for each address type is shown in **bold**.

Measured Channels

Address Type	Format	Range	Data Types	Access
Process Value of Channel	CHxxx or CHxxx.PV	001-040	Double , Float	Read Only
Alarm Summary of Channel	CHxxx.Alarm	001-040	Short , Word, Byte	Read Only
Alarm Level1 Status of Channel	CHxxx.Alarm1	001-040	Short , Word, Byte	Read Only
Alarm Level2 Status of Channel	CHxxx.Alarm2	001-040	Short , Word, Byte	Read Only
Alarm Level3 Status of Channel	CHxxx.Alarm3	001-040	Short , Word, Byte	Read Only
Alarm Level4 Status of Channel	CHxxx.Alarm4	001-040	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHxxx.ASP1	001-040	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHxxx.ASP2	001-040	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHxxx.ASP3	001-040	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHxxx.ASP4	001-040	Double , Float	Read/Write
Upper Scale Value of Channel*	CHxxx.scale_Hi	001-040	Double , Float	Read Only
Lower Scale Value of Channel*	CHxxx.scale_Lo	001-040	Double , Float	Read Only
Unit String of Channel*	CHxxx.unit	001-040	String	Read Only
Tagname of Channel*	CHxxx.tag	001-040	String	Read Only
Status of Channel*	CHxxx.status	001-040	String	Read Only
Lowest Measuring Channel*	CH.Low		Short , Word, Byte	Read Only
Highest Measuring Channel*	CH.High		Short , Word, Byte	Read Only

Math Channels

Address Type	Format	Range	Data Types	Access
Process Value of Math Channel	CHAxX or CHAxX.PV	01-30	Double , Float	Read Only
Alarm Summary of Math Channel	CHAxX.Alarm	01-30	Short , Word, Byte	Read Only
Alarm Level1 Status of Math Channel	CHAxX.Alarm1	01-30	Short , Word, Byte	Read Only
Alarm Level2 Status of Math Channel	CHAxX.Alarm2	01-30	Short , Word, Byte	Read Only
Alarm Level3 Status of Math Channel	CHAxX.Alarm3	01-30	Short , Word, Byte	Read Only
Alarm Level4 Status of Math Channel	CHAxX.Alarm4	01-30	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHAxX.ASP1	01-30	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHAxX.ASP2	01-30	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHAxX.ASP3	01-30	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHAxX.ASP4	01-30	Double , Float	Read/Write
Upper Scale Value of Math Channel*	CHAxX.scale_Hi	01-30	Double , Float	Read Only
Lower Scale Value of Math Channel*	CHAxX.scale_Lo	01-30	Double , Float	Read Only
Unit String of Math Channel*	CHAxX.unit	01-30	String	Read Only
Tagname of Math Channel*	CHAxX.tag	01-30	String	Read Only
Status of Math Channel*	CHAxX.status	01-30	String	Read Only

Lowest Math Channel*	CHA.Low		Short , Word, Byte	Read Only
Highest Math Channel*	CHA.High		Short , Word, Byte	Read Only

*The data associated with these addresses is only read from the device at the start of a communications session. Once read, the values will not be refreshed until the server has been restarted or the "Reset" tag has been invoked. To invoke a reset, write a non-zero value to the Reset tag. Once the Reset tag has been invoked, the driver will reinitialize all startup data from the device.

Alarm Setpoints

Data values for alarm setpoints that are undefined in the device will be returned as +INF. Data values can only be written to alarm setpoints that are defined in the device. Write operations to undefined alarm setpoints will return an error. Alarm setpoint values are read one channel at a time. For devices with a large number of channels, increasing the scan rate of ASP items and/or reducing the number of active ASP items will increase the read performance of the PV and alarm data.

Scales

Data values for Scale_Hi and Scale_Lo for channels that are skipped will be returned as +INF.

Tag Names

For devices that do not support tag names (and channels that have unspecified tag names) the driver will construct an internal tag name based on the channel number. For example, the tag name of address 'CH001' will be returned as 'CH001'.

General Device Data

Address Type	Format	Range	Data Types	Access
Date of Last Data	Date		String	Read Only
Time of Last Data	Time		String	Read Only
Model Name of Device*	Model		String	Read Only
Math Communication Data**	CDxx	01-30	Short , Word, Byte	Write Only
Control Math Execution	MathControl		Short , Word, Byte	Write Only
Reset Alarms	AlarmReset		Boolean	Write Only
Control Command and Response	Command		String	Read/Write
Direct Reloading of Configuration	Reset		Boolean	Write Only

*The model address type that returns the model name of the device may return 'DR231' for models of type DR241 and 'DR232' for models of type DR242.

**The CD address type is only valid for devices equipped with the math option. Write operations to CD addresses for non-math equipped devices will return an error. The range of valid data for addresses 'CDxx' is -32000 to 32000. CD data values are converted in the device from a whole number to a real number based on the decimal point placement specified for the associated math channel. For example, the device would interpret a data value of 32000 written to a CD address location with a decimal point placement of .000 as 32.000.

Control Math Execution

The MathControl address type is only available for devices equipped with the math option. Write operations to the MathControl tag for non-math equipped devices will return an error.

Control Command and Response

The Command address allows the user to send a string command and receive a string response to and from the device. This means that any command can be sent to the device, including commands not directly supported by the driver. Write operations using the Command address should be performed with extreme caution.

Note 1: The actual number of addresses available for of each type depends on the Yokogawa device's configuration. If the driver finds at Runtime that an address is not present in the device, it will post an error message and remove the tag from its scan list.

Note 2: Addresses that have Write Only access are assigned a default access of Read/Write. Data values are unreadable for these addresses, however, and the associated tags are not included in the scan list. The current data value for these tags will always be 0 for numeric data types and null string for string data types.

DR232 Addressing

The driver supports the following addresses for this device. The default data type for each address type is shown in **bold**.

Measured Channels

Address Type	Format	Range	Data Types	Access
Process Value of Channel	CHxxx or CHxxx.PV	001-560	Double , Float	Read Only
Alarm Summary of Channel	CHxxx.Alarm	001-560	Short , Word, Byte	Read Only
Alarm Level1 Status of Channel	CHxxx.Alarm1	001-560	Short , Word, Byte	Read Only
Alarm Level2 Status of Channel	CHxxx.Alarm2	001-560	Short , Word, Byte	Read Only
Alarm Level3 Status of Channel	CHxxx.Alarm3	001-560	Short , Word, Byte	Read Only
Alarm Level4 Status of Channel	CHxxx.Alarm4	001-560	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHxxx.ASP1	001-560	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHxxx.ASP2	001-560	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHxxx.ASP3	001-560	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHxxx.ASP4	001-560	Double , Float	Read/Write
Upper Scale Value of Channel*	CHxxx.scale_Hi	001-560	Double , Float	Read Only
Lower Scale Value of Channel*	CHxxx.scale_Lo	001-560	Double , Float	Read Only
Unit String of Channel*	CHxxx.unit	001-560	String	Read Only
Tagname of Channel*	CHxxx.tag	001-560	String	Read Only
Status of Channel*	CHxxx.status	001-560	String	Read Only
Lowest Measuring Channel*	CH.Low		Short , Word, Byte	Read Only
Highest Measuring Channel*	CH.High		Short , Word, Byte	Read Only

Math Channels

Address Type	Format	Range	Data Types	Access
Process Value of Math Channel	CHAxX or CHAxX.PV	01-60	Double , Float	Read Only
Alarm Summary of Math Channel	CHAxX.Alarm	01-60	Short , Word, Byte	Read Only
Alarm Level1 Status of Math Channel	CHAxX.Alarm1	01-60	Short , Word, Byte	Read Only
Alarm Level2 Status of Math Channel	CHAxX.Alarm2	01-60	Short , Word, Byte	Read Only
Alarm Level3 Status of Math Channel	CHAxX.Alarm3	01-60	Short , Word, Byte	Read Only
Alarm Level4 Status of Math Channel	CHAxX.Alarm4	01-60	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHAxX.ASP1	01-60	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHAxX.ASP2	01-60	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHAxX.ASP3	01-60	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHAxX.ASP4	01-60	Double , Float	Read/Write
Upper Scale Value of Math Channel*	CHAxX.scale_Hi	01-60	Double , Float	Read Only
Lower Scale Value of Math Channel*	CHAxX.scale_Lo	01-60	Double , Float	Read Only
Unit String of Math Channel*	CHAxX.unit	01-60	String	Read Only
Tagname of Math Channel*	CHAxX.tag	01-60	String	Read Only
Status of Math Channel*	CHAxX.status	01-60	String	Read Only
Lowest Math Channel*	CHA.Low		Short , Word, Byte	Read Only
Highest Math Channel*	CHA.High		Short , Word, Byte	Read Only

*The data associated with these addresses is only read from the device at the start of a communications session. Once read, the values will not be refreshed until the server has been restarted or the "Reset" tag has been invoked. To invoke a reset, a non zero value must be written to the Reset tag. Once the Reset tag has been invoked, the driver will reinitialize all startup data from the device.

Alarm Setpoints

Data values for alarm setpoints that are undefined in the device will be returned as +INF. Data values can only be written to alarm setpoints that are defined in the device. Write operations to undefined alarm setpoints will return an error. Alarm setpoint values are read one channel at a time. For devices with a large number of channels, increasing the scan rate of ASP items and/or reducing the number of active ASP items will increase the read performance of the PV and alarm data.

Scales

Data values for Scale_Hi and Scale_Lo for channels that are skipped will be returned as +INF.

Tag Names

For devices that do not support tag names (and channels that have unspecified tag names) the driver will construct an internal tag name based on the channel number. For example, the tag name of address 'CH001' will be returned as 'CH001'.

General Device Data

Address Type	Format	Range	Data Types	Access
Date of Last Data	Date		String	Read Only
Time of Last Data	Time		String	Read Only
Model Name of Device*	Model		String	Read Only
Math Communication Data**	CDxx	01-60	Short , Word, Byte	Write Only
Control Math Execution	MathControl		Short , Word, Byte	Write Only
Reset Alarms	AlarmReset		Boolean	Write Only
Control Command and Response	Command		String	Read/Write
Direct Reloading of Configuration	Reset		Boolean	Write Only

*The model address type that returns the model name of the device may return 'DR231' for models of type DR241 and 'DR232' for models of type DR242.

**The CD address type is only valid for devices equipped with the math option. Write operations to CD addresses for non-math equipped devices will return an error. The range of valid data for addresses 'CDxx' is -32000 to 32000. CD data values are converted in the device from a whole number to a real number based on the decimal point placement specified for the associated math channel. For example, the device would interpret a data value of 32000 written to a CD address location with a decimal point placement of .000 as 32.000.

Control Math Execution

The MathControl address type is only available for devices equipped with the math option. Write operations to the MathControl tag for non-math equipped devices will return an error.

Control Command and Response

The Command address allows the user to send a string command and receive a string response to and from the device. This means that any command can be sent to the device, including commands not directly supported by the driver. Write operations using the Command address should be performed with extreme caution.

Note 1: The actual number of addresses available for of each type depends on the Yokogawa device's configuration. If the driver finds at Runtime that an address is not present in the device, it will post an error message and remove the tag from its scan list.

Note 2: Addresses that have Write Only access are assigned a default access of Read/Write. Data values are unreadable for these addresses, however, and the associated tags are not included in the scan list. The current data value for these tags will always be 0 for numeric data types and null string for string data types.

DR241 Addressing

The driver supports the following addresses for this device. The default data type for each address type is shown in **bold**.

Measured Channels

Address Type	Format	Range	Data Types	Access
Process Value of Channel	CHxxx or CHxxx.PV	001-040	Double , Float	Read Only
Alarm Summary of Channel	CHxxx.Alarm	001-040	Short , Word, Byte	Read Only
Alarm Level1 Status of Channel	CHxxx.Alarm1	001-040	Short , Word, Byte	Read Only
Alarm Level2 Status of Channel	CHxxx.Alarm2	001-040	Short , Word, Byte	Read Only
Alarm Level3 Status of Channel	CHxxx.Alarm3	001-040	Short , Word, Byte	Read Only
Alarm Level4 Status of Channel	CHxxx.Alarm4	001-040	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHxxx.ASP1	001-040	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHxxx.ASP2	001-040	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHxxx.ASP3	001-040	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHxxx.ASP4	001-040	Double , Float	Read/Write
Upper Scale Value of Channel*	CHxxx.scale_Hi	001-040	Double , Float	Read Only
Lower Scale Value of Channel*	CHxxx.scale_Lo	001-040	Double , Float	Read Only
Unit String of Channel*	CHxxx.unit	001-040	String	Read Only
Tagname of Channel*	CHxxx.tag	001-040	String	Read Only
Status of Channel*	CHxxx.status	001-040	String	Read Only
Lowest Measuring Channel*	CH.Low		Short , Word, Byte	Read Only
Highest Measuring Channel*	CH.High		Short , Word, Byte	Read Only

Math Channels

Address Type	Format	Range	Data Types	Access
Process Value of Math Channel	CHAx or CHAx.PV	01-30	Double , Float	Read Only
Alarm Summary of Math Channel	CHAx.Alarm	01-30	Short , Word, Byte	Read Only
Alarm Level1 Status of Math Channel	CHAx.Alarm1	01-30	Short , Word, Byte	Read Only
Alarm Level2 Status of Math Channel	CHAx.Alarm2	01-30	Short , Word, Byte	Read Only
Alarm Level3 Status of Math Channel	CHAx.Alarm3	01-30	Short , Word, Byte	Read Only
Alarm Level4 Status of Math Channel	CHAx.Alarm4	01-30	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHAx.ASP1	01-30	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHAx.ASP2	01-30	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHAx.ASP3	01-30	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHAx.ASP4	01-30	Double , Float	Read/Write
Upper Scale Value of Math Channel*	CHAx.scale_Hi	01-30	Double , Float	Read Only
Lower Scale Value of Math Channel*	CHAx.scale_Lo	01-30	Double , Float	Read Only
Unit String of Math Channel*	CHAx.unit	01-30	String	Read Only
Tagname of Math Channel*	CHAx.tag	01-30	String	Read Only
Status of Math Channel*	CHAx.status	01-30	String	Read Only
Lowest Math Channel*	CHA.Low		Short , Word, Byte	Read Only
Highest Math Channel*	CHA.High		Short , Word, Byte	Read Only

*The data associated with these addresses is only read from the device at the start of a communications session. Once read, the values will not be refreshed until the server has been restarted or the "Reset" tag has been invoked. To invoke a reset, write a non-zero value to the Reset tag. Once the Reset tag has been invoked, the driver will reinitialize all startup data from the device.

Alarm Setpoints

Data values for alarm setpoints that are undefined in the device will be returned as +INF. Data values can only be written to alarm setpoints that are defined in the device. Write operations to undefined alarm setpoints will return an error. Alarm setpoint values are read one channel at a time. For devices with a large number of channels, increasing the scan rate of ASP items and/or reducing the number of active ASP items will increase the read performance of the PV and alarm data.

Scales

Data values for Scale_Hi and Scale_Lo for channels that are skipped will be returned as +INF.

Tag Names

For devices that do not support tag names (and channels that have unspecified tag names) the driver will construct an internal tag name based on the channel number. For example, the tag name of address 'CH001' will be returned as 'CH001'.

General Device Data

Address Type	Format	Range	Data Types	Read/Write
Date of Last Data	Date		String	Read Only
Time of Last Data	Time		String	Read Only
Model Name of Device*	Model		String	Read Only
Math Communication Data**	CDxx	01-30	Short , Word, Byte	Write Only
Control Math Execution	MathControl		Short , Word, Byte	Write Only
Reset Alarms	AlarmReset		Boolean	Write Only
Control Command and Response	Command		String	Read/Write
Direct Reloading of Configuration	Reset		Boolean	Write Only

*The model address type that returns the model name of the device may return 'DR231' for models of type DR241 and 'DR232' for models of type DR242.

**The CD address type is only valid for devices equipped with the math option. Write operations to CD addresses for non-math equipped devices will return an error. The range of valid data for addresses 'CDxx' is -32000 to 32000. CD data values are converted in the device from a whole number to a real number based on the decimal point placement specified for the associated math channel. For example, the device would interpret a data value of 32000 written to a CD address location with a decimal point placement of .000 as 32.000.

Control Math Execution

The MathControl address type is only available for devices equipped with the math option. Write operations to the MathControl tag for non-math equipped devices will return an error.

Control Command and Response

The Command address allows the user to send a string command and receive a string response to and from the device. This means that any command can be sent to the device, including commands not directly supported by the driver. Write operations using the Command address should be performed with extreme caution.

Note 1: The actual number of addresses available for of each type depends on the Yokogawa device's configuration. If the driver finds at Runtime that an address is not present in the device, it will post an error message and remove the tag from its scan list.

Note 2: Addresses that have Write Only access are assigned a default access of Read/Write. Data values are unreadable for these addresses, however, and the associated tags are not included in the scan list. The current data value for these tags will always be 0 for numeric data types and null string for string data types.

DR242 Addressing

The driver supports the following addresses for this device. The default data type for each address type is shown in **bold**.

Measured Channels

Address Type	Format	Range	Data Types	Access
Process Value of Channel	CHxxx or CHxxx.PV	001-560	Double , Float	Read Only
Alarm Summary of Channel	CHxxx.Alarm	001-560	Short , Word, Byte	Read Only
Alarm Level1 Status of Channel	CHxxx.Alarm1	001-560	Short , Word, Byte	Read Only
Alarm Level2 Status of Channel	CHxxx.Alarm2	001-560	Short , Word, Byte	Read Only
Alarm Level3 Status of Channel	CHxxx.Alarm3	001-560	Short , Word, Byte	Read Only
Alarm Level4 Status of Channel	CHxxx.Alarm4	001-560	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHxxx.ASP1	001-560	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHxxx.ASP2	001-560	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHxxx.ASP3	001-560	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHxxx.ASP4	001-560	Double , Float	Read/Write
Upper Scale Value of Channel*	CHxxx.scale_Hi	001-560	Double , Float	Read Only
Lower Scale Value of Channel*	CHxxx.scale_Lo	001-560	Double , Float	Read Only
Unit String of Channel*	CHxxx.unit	001-560	String	Read Only
Tagname of Channel*	CHxxx.tag	001-560	String	Read Only
Status of Channel*	CHxxx.status	001-560	String	Read Only
Lowest Measuring Channel*	CH.Low		Short , Word, Byte	Read Only
Highest Measuring Channel*	CH.High		Short , Word, Byte	Read Only

Math Channels

Address Type	Format	Range	Data Types	Access
Process Value of Math Channel	CHAxX or CHAxX.PV	01-60	Double , Float	Read Only
Alarm Summary of Math Channel	CHAxX.Alarm	01-60	Short , Word, Byte	Read Only
Alarm Level1 Status of Math Channel	CHAxX.Alarm1	01-60	Short , Word, Byte	Read Only
Alarm Level2 Status of Math Channel	CHAxX.Alarm2	01-60	Short , Word, Byte	Read Only
Alarm Level3 Status of Math Channel	CHAxX.Alarm3	01-60	Short , Word, Byte	Read Only
Alarm Level4 Status of Math Channel	CHAxX.Alarm4	01-60	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHAxX.ASP1	01-60	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHAxX.ASP2	01-60	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHAxX.ASP3	01-60	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHAxX.ASP4	01-60	Double , Float	Read/Write
Upper Scale Value of Math Channel*	CHAxX.scale_Hi	01-60	Double , Float	Read Only
Lower Scale Value of Math Channel*	CHAxX.scale_Lo	01-60	Double , Float	Read Only
Unit String of Math Channel*	CHAxX.unit	01-60	String	Read Only
Tagname of Math Channel*	CHAxX.tag	01-60	String	Read Only
Status of Math Channel*	CHAxX.status	01-60	String	Read Only
Lowest Math Channel*	CHA.Low		Short , Word, Byte	Read Only
Highest Math Channel*	CHA.High		Short , Word, Byte	Read Only

*The data associated with these addresses is only read from the device at the start of a communications session. Once read, the values will not be refreshed until the server has been restarted or the "Reset" tag has been

invoked. To invoke a reset, write a non-zero value to the Reset tag. Once the Reset tag has been invoked, the driver will reinitialize all startup data from the device.

Alarm Setpoints

Data values for alarm setpoints that are undefined in the device will be returned as +INF. Data values can only be written to alarm setpoints that are defined in the device. Write operations to undefined alarm setpoints will return an error. Alarm setpoint values are read one channel at a time. For devices with a large number of channels, increasing the scan rate of ASP items and/or reducing the number of active ASP items will increase the read performance of the PV and alarm data.

Scales

Data values for Scale_Hi and Scale_Lo for channels that are skipped will be returned as +INF.

Tag Names

For devices that do not support tag names (and channels that have unspecified tag names) the driver will construct an internal tag name based on the channel number. For example, the tag name of address 'CH001' will be returned as 'CH001'.

General Device Data

Address Type	Format	Range	Data Types	Access
Date of Last Data	Date		String	Read Only
Time of Last Data	Time		String	Read Only
Model Name of Device*	Model		String	Read Only
Math Communication Data**	CDxx	01-60	Short, Word, Byte	Write Only
Control Math Execution	MathControl		Short, Word, Byte	Write Only
Reset Alarms	AlarmReset		Boolean	Write Only
Control Command and Response	Command		String	Read/Write
Direct Reloading of Configuration	Reset		Boolean	Write Only

*The model address type that returns the model name of the device may return 'DR231' for models of type DR241 and 'DR232' for models of type DR242.

**The CD address type is only valid for devices equipped with the math option. Write operations to CD addresses for non-math equipped devices will return an error. The range of valid data for addresses 'CDxx' is -32000 to 32000. CD data values are converted in the device from a whole number to a real number based on the decimal point placement specified for the associated math channel. For example, the device would interpret a data value of 32000 written to a CD address location with a decimal point placement of .000 as 32.000.

Control Math Execution

The MathControl address type is only available for devices equipped with the math option. Write operations to the MathControl tag for non-math equipped devices will return an error.

Control Command and Response

The Command address allows the user to send a string command and receive a string response to and from the device. This means that any command can be sent to the device, including commands not directly supported by the driver. Write operations using the Command address should be performed with extreme caution.

Note 1: The actual number of addresses available for of each type depends on the Yokogawa device's configuration. If the driver finds at Runtime that an address is not present in the device, it will post an error message and remove the tag from its scan list.

Note 2: Addresses that have Write Only access are assigned a default access of Read/Write. Data values are unreadable for these addresses, however, and the associated tags are not included in the scan list. The current data value for these tags will always be 0 for numeric data types and null string for string data types.

DC100-1 Addressing

The driver supports the following addresses for this device. The default data type for each address type is shown in **bold**.

Measured Channels

Address Type	Format	Range	Data Types	Access
Process Value of Channel	CHxx or CHxx.PV	001-060	Double , Float	Read Only
Alarm Summary of Channel	CHxx.Alarm	001-060	Short , Word, Byte	Read Only
Alarm Level1 Status of Channel	CHxx.Alarm1	001-060	Short , Word, Byte	Read Only

Alarm Level2 Status of Channel	CHxxx.Alarm2	001-060	Short , Word, Byte	Read Only
Alarm Level3 Status of Channel	CHxxx.Alarm3	001-060	Short , Word, Byte	Read Only
Alarm Level4 Status of Channel	CHxxx.Alarm4	001-060	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHxxx.ASP1	001-060	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHxxx.ASP2	001-060	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHxxx.ASP3	001-060	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHxxx.ASP4	001-060	Double , Float	Read/Write
Upper Scale Value of Channel*	CHxxx.scale_Hi	001-060	Double , Float	Read Only
Lower Scale Value of Channel*	CHxxx.scale_Lo	001-060	Double , Float	Read Only
Unit String of Channel*	CHxxx.unit	001-060	String	Read Only
Tagname of Channel*	CHxxx.tag	001-060	String	Read Only
Status of Channel*	CHxxx.status	001-060	String	Read Only
Lowest Measuring Channel*	CH.Low		Short , Word, Byte	Read Only
Highest Measuring Channel*	CH.High		Short , Word, Byte	Read Only

Math Channels

Address Type	Format	Range	Data Types	Access
Process Value of Math Channel	CHAxX or CHAxX.PV	01-30	Double , Float	Read Only
Alarm Summary of Math Channel	CHAxX.Alarm	01-30	Short , Word, Byte	Read Only
Alarm Level1 Status of Math Channel	CHAxX.Alarm1	01-30	Short , Word, Byte	Read Only
Alarm Level2 Status of Math Channel	CHAxX.Alarm2	01-30	Short , Word, Byte	Read Only
Alarm Level3 Status of Math Channel	CHAxX.Alarm3	01-30	Short , Word, Byte	Read Only
Alarm Level4 Status of Math Channel	CHAxX.Alarm4	01-30	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHAxX.ASP1	01-30	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHAxX.ASP2	01-30	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHAxX.ASP3	01-30	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHAxX.ASP4	01-30	Double , Float	Read/Write
Upper Scale Value of Math Channel*	CHAxX.scale_Hi	01-30	Double , Float	Read Only
Lower Scale Value of Math Channel*	CHAxX.scale_Lo	01-30	Double , Float	Read Only
Unit String of Math Channel*	CHAxX.unit	01-30	String	Read Only
Tagname of Math Channel*	CHAxX.tag	01-30	String	Read Only
Status of Math Channel*	CHAxX.status	01-30	String	Read Only
Lowest Math Channel*	CHA.Low		Short , Word, Byte	Read Only
Highest Math Channel*	CHA.High		Short , Word, Byte	Read Only

*The data associated with these addresses is only read from the device at the start of a communications session. Once read, the values will not be refreshed until the server has been restarted or the "Reset" tag has been invoked. To invoke a reset, write a non-zero value to the Reset tag. Once the Reset tag has been invoked, the driver will reinitialize all startup data from the device.

Alarm Setpoints

Data values for alarm setpoints that are undefined in the device will be returned as +INF. Data values can only be written to alarm setpoints that are defined in the device. Write operations to undefined alarm setpoints will return an error. Alarm setpoint values are read one channel at a time. For devices with a large number of channels, increasing the scan rate of ASP items and/or reducing the number of active ASP items will increase the read performance of the PV and alarm data.

Scales

Data values for Scale_Hi and Scale_Lo for channels that are skipped will be returned as +INF.

Tag Names

For devices that do not support tag names (and channels that have unspecified tag names) the driver will construct an internal tag name based on the channel number. For example, the tag name of address 'CH001' will be returned as 'CH001'.

General Device Data

Address Type	Format	Range	Data Types	Access
Date of Last Data	Date		String	Read Only
Time of Last Data	Time		String	Read Only

Model Name of Device*	Model		String	Read Only
Math Communication Data**	CDxx	01-30	Short , Word, Byte	Write Only
Control Math Execution	MathControl		Short , Word, Byte	Write Only
Reset Alarms	AlarmReset		Boolean	Write Only
Control Command and Response	Command		String	Read/Write
Direct Reloading of Configuration	Reset		Boolean	Write Only

*The model address type that returns the model name of the device may return 'DR231' for models of type DR241 and 'DR232' for models of type DR242.

**The CD address type is only valid for devices equipped with the math option. Write operations to CD addresses for non-math equipped devices will return an error. The range of valid data for addresses 'CDxx' is -32000 to 32000. CD data values are converted in the device from a whole number to a real number based on the decimal point placement specified for the associated math channel. For example, the device would interpret a data value of 32000 written to a CD address location with a decimal point placement of .000 as 32.000.

Control Math Execution

The MathControl address type is only available for devices equipped with the math option. Write operations to the MathControl tag for non-math equipped devices will return an error.

Control Command and Response

The Command address allows the user to send a string command and receive a string response to and from the device. This means that any command can be sent to the device, including commands not directly supported by the driver. Write operations using the Command address should be performed with extreme caution.

Note 1: The actual number of addresses available for of each type depends on the Yokogawa device's configuration. If the driver finds at Runtime that an address is not present in the device, it will post an error message and remove the tag from its scan list.

Note 2: Addresses that have Write Only access are assigned a default access of Read/Write. Data values are unreadable for these addresses, however, and the associated tags are not included in the scan list. The current data value for these tags will always be 0 for numeric data types and null string for string data types.

DC100-2 Addressing

The driver supports the following addresses for this device. The default data type for each address type is shown in **bold**.

Measured Channels

Address Type	Format	Range	Data Types	Access
Process Value of Channel	CHxxx or CHxxx.PV	001-560	Double , Float	Read Only
Alarm Summary of Channel	CHxxx.Alarm	001-560	Short , Word, Byte	Read Only
Alarm Level1 Status of Channel	CHxxx.Alarm1	001-560	Short , Word, Byte	Read Only
Alarm Level2 Status of Channel	CHxxx.Alarm2	001-560	Short , Word, Byte	Read Only
Alarm Level3 Status of Channel	CHxxx.Alarm3	001-560	Short , Word, Byte	Read Only
Alarm Level4 Status of Channel	CHxxx.Alarm4	001-560	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHxxx.ASP1	001-560	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHxxx.ASP2	001-560	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHxxx.ASP3	001-560	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHxxx.ASP4	001-560	Double , Float	Read/Write
Upper Scale Value of Channel*	CHxxx.scale_Hi	001-560	Double , Float	Read Only
Lower Scale Value of Channel*	CHxxx.scale_Lo	001-560	Double , Float	Read Only
Unit String of Channel*	CHxxx.unit	001-560	String	Read Only
Tagname of Channel*	CHxxx.tag	001-560	String	Read Only
Status of Channel*	CHxxx.status	001-560	String	Read Only
Lowest Measuring Channel*	CH.Low		Short , Word, Byte	Read Only
Highest Measuring Channel*	CH.High		Short , Word, Byte	Read Only

Math Channels

Address Type	Format	Range	Data Types	Access
Process Value of Math Channel	CHAxX or CHAxX.PV	01-60	Double , Float	Read Only

Alarm Summary of Math Channel	CHAx.x.Alarm	01-60	Short , Word, Byte	Read Only
Alarm Level1 Status of Math Channel	CHAx.x.Alarm1	01-60	Short , Word, Byte	Read Only
Alarm Level2 Status of Math Channel	CHAx.x.Alarm2	01-60	Short , Word, Byte	Read Only
Alarm Level3 Status of Math Channel	CHAx.x.Alarm3	01-60	Short , Word, Byte	Read Only
Alarm Level4 Status of Math Channel	CHAx.x.Alarm4	01-60	Short , Word, Byte	Read Only
Set and Read Level1 Alarm Setpoint	CHAx.x.ASP1	01-60	Double , Float	Read/Write
Set and Read Level2 Alarm Setpoint	CHAx.x.ASP2	01-60	Double , Float	Read/Write
Set and Read Level3 Alarm Setpoint	CHAx.x.ASP3	01-60	Double , Float	Read/Write
Set and Read Level4 Alarm Setpoint	CHAx.x.ASP4	01-60	Double , Float	Read/Write
Upper Scale Value of Math Channel*	CHAx.x.scale_Hi	01-60	Double , Float	Read Only
Lower Scale Value of Math Channel*	CHAx.x.scale_Lo	01-60	Double , Float	Read Only
Unit String of Math Channel*	CHAx.x.unit	01-60	String	Read Only
Tagname of Math Channel*	CHAx.x.tag	01-60	String	Read Only
Status of Math Channel*	CHAx.x.status	01-60	String	Read Only
Lowest Math Channel*	CHA.Low		Short , Word, Byte	Read Only
Highest Math Channel*	CHA.High		Short , Word, Byte	Read Only

*The data associated with these addresses is only read from the device at the start of a communications session. Once read, the values will not be refreshed until the server has been restarted or the "Reset" tag has been invoked. To invoke a reset, write a non-zero value to the Reset tag. Once the Reset tag has been invoked, the driver will reinitialize all startup data from the device.

Alarm Setpoints

Data values for alarm setpoints that are undefined in the device will be returned as +INF. Data values can only be written to alarm setpoints that are defined in the device. Write operations to undefined alarm setpoints will return an error. Alarm setpoint values are read one channel at a time. For devices with a large number of channels, increasing the scan rate of ASP items and/or reducing the number of active ASP items will increase the read performance of the PV and alarm data.

Scales

Data values for Scale_Hi and Scale_Lo for channels that are skipped will be returned as +INF.

Tag Names

For devices that do not support tag names (and channels that have unspecified tag names) the driver will construct an internal tag name based on the channel number. For example, the tag name of address 'CH001' will be returned as 'CH001'.

General Device Data

Address Type	Format	Range	Data Types	Access
Date of Last Data	Date		String	Read Only
Time of Last Data	Time		String	Read Only
Model Name of Device*	Model		String	Read Only
Math Communication Data**	CDxx	01-60	Short , Word, Byte	Write Only
Control Math Execution	MathControl		Short , Word, Byte	Write Only
Reset Alarms	AlarmReset		Boolean	Write Only
Control Command and Response	Command		String	Read/Write
Direct Reloading of Configuration	Reset		Boolean	Write Only

*The model address type that returns the model name of the device may return 'DR231' for models of type DR241 and 'DR232' for models of type DR242.

**The CD address type is only valid for devices equipped with the math option. Write operations to CD addresses for non-math equipped devices will return an error. The range of valid data for addresses 'CDxx' is -32000 to 32000. CD data values are converted in the device from a whole number to a real number based on the decimal point placement specified for the associated math channel. For example, the device would interpret a data value of 32000 written to a CD address location with a decimal point placement of .000 as 32.000.

Control Math Execution

The MathControl address type is only available for devices equipped with the math option. Write operations to the MathControl tag for non-math equipped devices will return an error.

Control Command and Response

The Command address allows the user to send a string command and receive a string response to and from the device. This means that any command can be sent to the device, including commands not directly supported by the driver. Write operations using the Command address should be performed with extreme caution.

Note 1: The actual number of addresses available for of each type depends on the Yokogawa device's configuration. If the driver finds at Runtime that an address is not present in the device, it will post an error message and remove the tag from its scan list.

Note 2: Addresses that have Write Only access are assigned a default access of Read/Write. Data values are unreadable for these addresses, however, and the associated tags are not included in the scan list. The current data value for these tags will always be 0 for numeric data types and null string for string data types.


Automatic Tag Database Generation

This driver's Automatic OPC Tag Database Generation features are designed to make configuring the OPC application a plug-and-play operation. This driver can be configured to automatically build a list of OPC tags within OPC server that correspond to device-specific data. The automatically-generated OPC tags can then be browsed from the OPC client.

The OPC tags that are generated depend on the nature of the driver. If the target device supports its own local tag database, the driver will read the device's tag information and then use this data to generate OPC tags within the OPC server. If the device does not natively support its own named tags, the driver will create a list of tags based on driver-specific information. An example of these two conditions is follows:

1. A data acquisition system that supports its own local tag database. The driver will use the tag names found in the device to build the OPC Server's OPC tags.
2. An Ethernet I/O system that supports detection of I/O module type. The driver will automatically generate OPC tags in the OPC Server that are based on the types of I/O modules plugged into the Ethernet I/O rack.

Automatic Tag Database Generation is completely configurable. The following dialog is used to define how the OPC server and the associated communications driver will handle automatic OPC tag database generation:

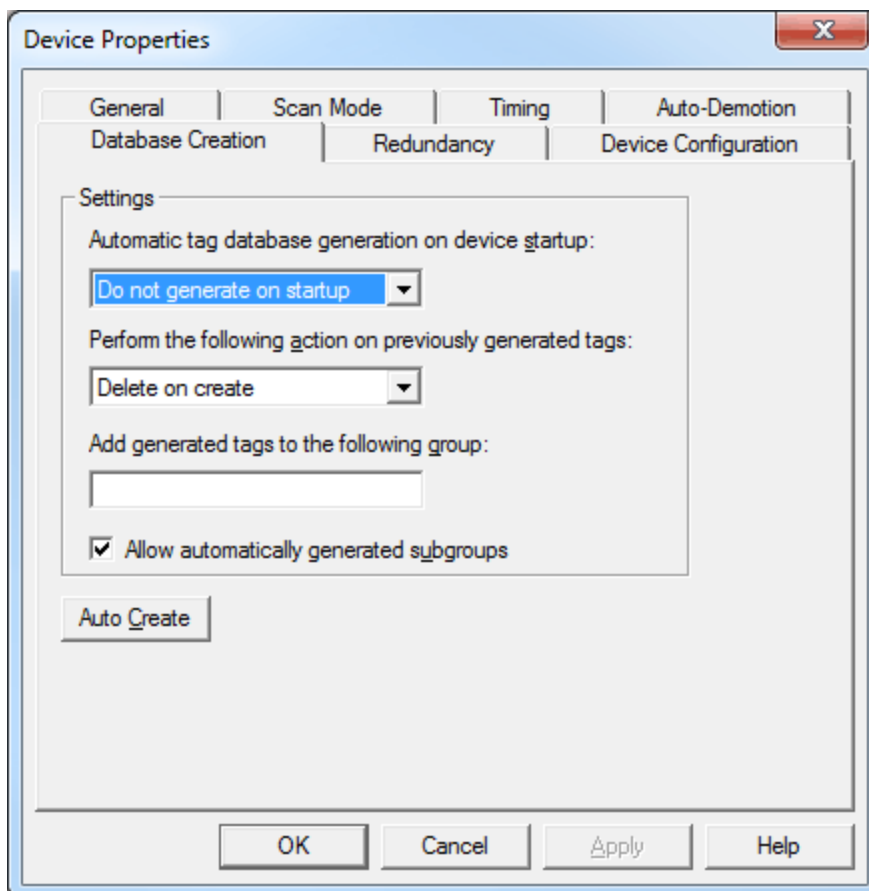

The **Automatic tag database generation on device startup** selection is used to configure when OPC tags will be automatically generated. Descriptions of the parameters are as follows:

- **Do not generate on startup:** This option prevents the driver from adding any OPC tags to the OPC server's tag space. This is the default setting.
- **Always generate on startup:** This option causes the driver to always evaluate the device for tag information. OPC tags will be added to the tag space of the server each time the server is launched.
- **Generate on first startup:** This option causes the driver to evaluate the target device for tag information the first time the OPC server project is run. OPC tags will be added to the server tag space as needed.


Note: Any tags that are added to the server's tag space must be saved with the project. The OPC server project can be configured to automatically save from the **Tools | Options** menu.

When automatic tag generation is enabled, the server needs to know what to do with OPC tags that were added from previous runs (or with the OPC tags that were added or modified after being added by the communications driver originally). The selection **Perform the following action** controls how the server will handle OPC tags that were automatically generated and currently exist in the OPC server project. This feature prevents automatically-generated tags from piling up in the server. In the Ethernet I/O example above, the I/O modules continued to change in the rack with the OPC server configured to always generate new OPC tags on startup. Under this condition, tags would be added to the server every time the communications driver detected a new I/O module. If the old tags are not removed, they will accumulate in the server's tag space. Descriptions of the selections are as follows:


1. **Delete on create:** This option allows the server to remove any tags that have previously been added to the tag space before any new tags can be added by the communications driver. This is the default setting.
2. **Overwrite as necessary:** This option allows the server to only remove tags that the communications driver will replace with new tags. Any tags that are not being overwritten will remain in the server's tag space.
3. **Do not overwrite:** This option prevents the server from removing any tags that had previously been generated or that already exist in the server. With this selection, the communications driver can only add tags that are completely new.
4. **Do not overwrite, log error:** This option has the same effect as the third option, but also posts an error message to the OPC Server's Event Log when a tag overwrite would have occurred.

Note: The removal of OPC tags not only affects tags that have been automatically generated by the communications driver, but also any tags that have been added using names that match generated tags. It is recommended that users avoid adding tags to the server using names that match tags that may be automatically generated by the driver.

Add generated tags to the following group can be used to keep automatically-generated tags from mixing with tags that have been entered manually. This parameter specifies a sub group that will be used when adding all automatically-generated tags for this device. The name of the sub group can be up to 31 characters in length. The following image displays demonstrate how this parameter affects where automatically-generated tags are placed in the server's tag space. It provides a root branch to which all automatically-generated tags will be added.

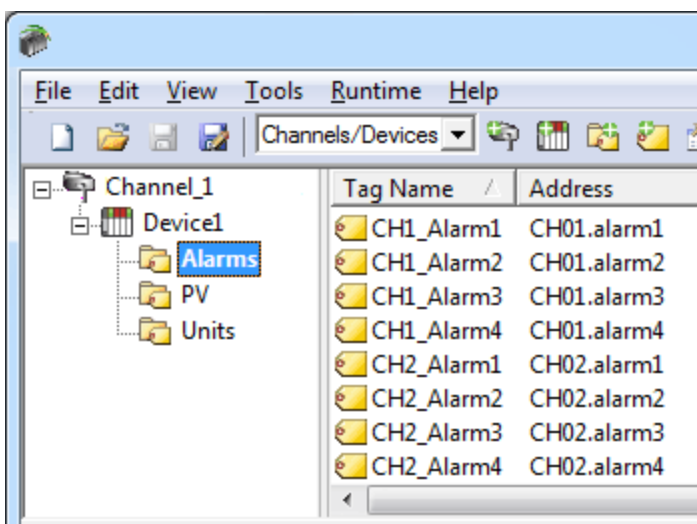

No sub group specified.

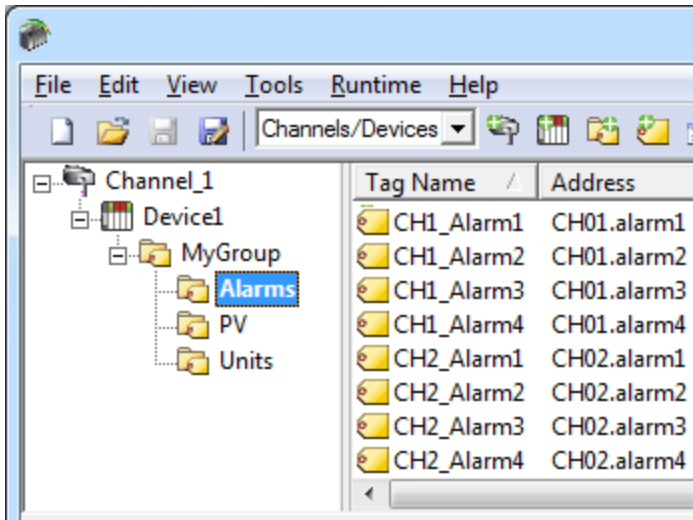

Sub group named MyGroup specified.

Auto Create manually initiates the creation of automatically-generated OPC tags, and also forces the communications driver to reevaluate the device for possible tag changes. It can be accessed from the System Tags, thus allowing the OPC client application to initiate tag database creation.

Error Descriptions

The following error/warning messages may be generated. Click on the link for a description of the message.

Address Validation

[Address '<address>' is out of range for the specified device or register](#)

[Data Type '<type>' is not valid for device address '<address>'](#)

[Device address '<address>' contains a syntax error](#)

[Device address '<address>' is Read Only](#)

[Missing address](#)

[The device '<device name>' responded with a NAK to a read request starting at address '<address>'. The requested address may not exist in the device](#)

Serial Communications

[Communications error on '<channel name>' \[<error mask>\]](#)

[COMn does not exist](#)

[COMn is in use by another application](#)

[Error opening COMn](#)

[Unable to set comm parameters on COMn](#)

Device Status Messages

[Device '<device name>' is not responding](#)

[Unable to write to '<address>' on device '<device name>'](#)

Address Validation

The following error/warning messages may be generated. Click on the link for a description of the message.

Address Validation

[Address '<address>' is out of range for the specified device or register](#)

[Data Type '<type>' is not valid for device address '<address>'](#)

[Device address '<address>' contains a syntax error](#)

[Device address '<address>' is Read Only](#)

[Missing address](#)

[The device '<device name>' responded with a NAK to a read request starting at address '<address>'. The requested address may not exist in the device](#)

Address '<address>' is out of range for the specified device or register

Error Type:

Warning

Possible Cause:

A tag address that has been specified statically references a location that is beyond the range of supported locations for the device.

Solution:

Verify that the address is correct; if it is not, re-enter it in the client application.

Data Type '<type>' is not valid for device address '<address>'

Error Type:

Warning

Possible Cause:

A tag address that has been specified statically has been assigned an invalid data type.

Solution:

Modify the requested data type in the client application.

Device address '<address>' contains a syntax error

Error Type:

Warning

Possible Cause:

A tag address that has been specified statically contains one or more invalid characters.

Solution:

Re-enter the address in the client application.

Device address '<address>' is Read Only

Error Type:

Warning

Possible Cause:

A tag address that has been specified statically has a requested access mode that is not compatible with what the device supports for that address.

Solution:

Change the access mode in the client application.

Missing address

Error Type:

Warning

Possible Cause:

A tag address that has been specified statically has no length.

Solution:

Re-enter the address in the client application.

The device '<device name>' responded with a NAK to a read request starting at address '<address>'. The requested address may not exist in the device

Error Type:

Warning

Possible Cause:

The requested address may not exist in the device.

Solution:

Verify that the address is correct; if it is not, re-enter it in the client application.

Serial Communications

The following error/warning messages may be generated. Click on the link for a description of the message.

Serial Communications

[Communications error on '<channel name>' \[<error mask>\]](#)

[COMn does not exist](#)

[COMn is in use by another application](#)

[Error opening COMn](#)

[Unable to set comm parameters on COMn](#)

Communications error on '<channel name>' [<error mask>]

Error Type:

Serious

Error Mask Definitions:

B = Hardware break detected.

F = Framing error.

E = I/O error.

O = Character buffer overrun.

R = RX buffer overrun.

P = Received byte parity error.

T = TX buffer full.

Possible Cause:

1. The serial connection between the device and the Host PC is bad.
2. The communications parameters for the serial connection are incorrect.

Solution:

1. Verify the cabling between the PC and the PLC device.
2. Verify that the specified communications parameters match those of the device.

COMn does not exist

Error Type:

Fatal

Possible Cause:

The specified COM port is not present on the target computer.

Solution:

Verify that the proper COM port has been selected.

COMn is in use by another application

Error Type:

Fatal

Possible Cause:

The serial port assigned to a device is being used by another application.

Solution:

1. Verify that the correct port has been assigned to the channel.
2. Verify that only one copy of the current project is running.

Error opening COMn

Error Type:

Fatal

Possible Cause:

The specified COM port could not be opened due an internal hardware or software problem on the target computer.

Solution:

Verify that the COM port is functional and may be accessed by other Windows applications.

Unable to set comm parameters on COMn

Error Type:

Fatal

Possible Cause:

The serial parameters for the specified COM port are not valid.

Solution:

Verify the serial parameters and make any necessary changes.

Device Status Messages

The following error/warning messages may be generated. Click on the link for a description of the message.

Device Status Messages

[Device '<device name>' is not responding](#)

[Unable to write to '<address>' on device '<device name>'](#)

Device '<device name>' is not responding

Error Type:

Serious

Possible Cause:

1. The connection between the device and the Host PC is broken.
2. The IP address assigned to the device is incorrect.
3. The connection cannot be established in the specified timeout period.
4. The response cannot be received in the specified timeout period.
5. The response from the device took longer to receive than the amount of time specified in the "Request Timeout" device setting.

Solution:

1. Verify the cabling between the PC and the PLC device.
2. Verify the IP address given to the named device matches that of the actual device.
3. Increase the Connect Timeout value in the Timeout page of Device Properties.
4. Increase the Request Timeout value in the Timeout page of Device Properties.
5. Increase the Request Timeout setting so that the entire response can be handled.

Unable to write to '<address>' on device '<device name>'

Error Type:

Serious

Possible Cause:

1. The connection between the device and the Host PC is broken.
2. The named device may have been assigned an incorrect IP address.
3. The address specified may be Read Only or may not exist in the current device.

Solution:

1. Verify the cabling between the PC and the PLC device.
2. Verify the IP address given to the named device matches that of the actual device.
3. Check address availability for the device.

Index

A

Address '<address>' is out of range for the specified device or register.....	32
Address Descriptions.....	13
Address Validation.....	32
Automatic Tag Database Generation.....	29

B

Boolean.....	12
--------------	----

C

Communications error on '<channel name>' [<error mask>].....	33
Communications Parameters.....	10
COMn does not exist.....	34
COMn is in use by another application.....	34

D

DA100-1 Addressing.....	13
DA100-2 Addressing.....	14
Data Type '<type>' is not valid for device address '<address>'.....	32
Data Types Description.....	12
DC100-1 Addressing.....	24
DC100-2 Addressing.....	26
Device '<device name>' is not responding.....	35
Device address '<address>' contains a syntax error.....	32
Device address '<address>' is Read Only.....	33
Device ID.....	4
Device Setup.....	4
Device Status Messages.....	34
DR130 Addressing.....	16
DR231 Addressing.....	18

DR232 Addressing	19
DR241 Addressing	21
DR242 Addressing	23

E

Error Descriptions2	32
Error opening COMn	34

F

Float	12
--------------------	-----------

M

Missing address	33
Modem Setup	8

N

Network	4
----------------------	----------

O

Overview	3
-----------------------	----------

S

Serial Communications	33
Short	12

T

The device '<device name>' responded with a NAK to a read request starting at address 33
'<address>'. The requested address may not exist in the device

U

Unable to set comm parameters on COMn..... 34
Unable to write tag '<address>' on device '<device name>'..... 35

W

Word..... 12